
Design No. CEJ 119 P


PERIMETER FIRE BARRIER SYSTEM

T Rating - 1/4 hr.

F-Rating - 2 hr

L-Rating <1 SCFM/LF

Rated for $\pm 16.7\%$ movement

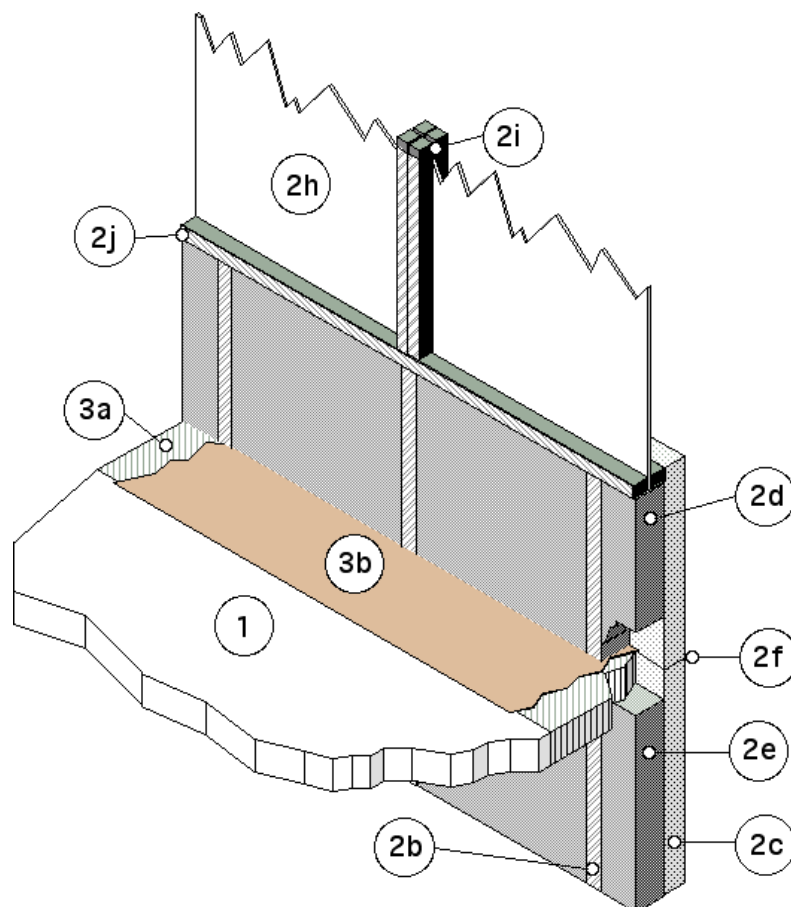

1. CONCRETE FLOOR ASSEMBLY: Two-hour rated concrete floor assembly made from either lightweight or normal weight concrete with a density of 100-150 pcf, with a min. thickness of 4-1/2-in. at the joint face. Overall slab thickness may vary to accommodate various blockout depths (longitudinal recesses) formed in the concrete, to house the architectural cover plate. The blockout width may also vary without restriction.
2. CURTAIN WALL ASSEMBLY: The curtain wall assembly shall incorporate the following construction features:
 - A. Mounting Attachments: (Not shown) Attachment of the curtain wall framing to the structural framing shall be according to the curtain wall manufacturer's instructions. When required, the mounting attachments to the floor slab shall be connected to the joint face of the floor slab, according to the curtain wall manufacturer's instructions.

Maximum distance horizontally between mounting attachments shall be 10 feet.

- B. Steel-Stud Framing: Vertical framing members shall be a min. 3-5/8 in. by 1-5/8 in., 18 GA steel "C" studs. Attachment shall be according to the curtain wall system manufacturer's guidelines. Vertical framing not to exceed a spacing of 60 in. o.c. and shall be completely covered by the concrete panels. Horizontal framing members shall be installed according to the curtain wall system manufacturer's guidelines and, in the spandrel area, are required to be installed to a minimum of 33 in. above the top surface of the floor.
- C. Concrete Panels: Any non-combustible exterior concrete based panel. Panels shall not be less than 2-1/2 in. thick, 12 in. high or 12 in. long. Attachment to the framing shall be according to the curtain wall system manufacturer's guidelines.
- D. Impaling Pins: (Not Shown) When required by insulation manufacturer, use with insulation. The pins shall be located, sized and installed according to the curtain wall system manufacturer's guidelines.
- E. Curtain Wall Insulation (Optional): Perimeter joint treatment shall be installed before curtain wall insulation. Insulation material designed and installed according to the curtain wall system manufacturer's guidelines for steel framing. Insulation shall be installed flush against the top and bottom surfaces of the perimeter joint protection with out deforming it. Either mineral wool or fiberglass batt insulation may be used.
- F. Concrete Panel Joint: Vertical and horizontal concrete panel joints created between panels can be either flush type (butt joint) or key way type (tongue and groove). Concrete panel edges must be in contact with each other. If required, the surface of the panel joints can be sealed with gaskets or sealants.
- G. Framing Covers (Optional, not shown): When used, the framing covers shall be located, sized and installed according to the curtain wall system manufacturer's guidelines. Framing covers do not pass

through the perimeter joint treatment. They are butted to the top and bottom surfaces of the perimeter joint treatment without deforming it.

The following vision glass panel detail is included as an optional installation detail outside the spandrel area:

- H. Glass Vision Panels: Glass vision panels shall be a min. 33 in. above the top surface of the floor assembly. Glass vision panels shall be installed to curtain wall framing according to the curtain wall system manufacturer's guidelines. Use a min. 1/4 in. thick, clear tempered glass with a nom. width and height as determined by the framing.
 - I. Window Gaskets: Secure glass vision panels with a thermal break (thermal-set rubber extrusion).
 - J. Window Framing: Steel framing members shall be a min. 3-5/8-in. by 1-5/8-in. 18 GA steel "U" channel or similar construction that is compatible with steel-stud framing (2b). Locate window framing at least 33 in. above the top surface of the floor assembly.
3. PERIMETER JOINT PROTECTION: The perimeter joint (linear opening) shall not exceed 8" (joint width measured between deck edge and interior face of curtain wall framing) and the perimeter joint treatment shall incorporate the following construction features:
- A. Packing Material: Cut 4" thick, 4 pcf mineral wool batt insulation** into minimum 4" widths. Rotate the cut pieces to align the fibers parallel to the slab edge. The packing material shall be compressed 50% in the nominal joint. Compress the batt insulation into the perimeter joint with the top surface of the batt insulation flush with the top of the concrete slab. Splices (butt joints) in the lengths of mineral wool batt insulation are to be tightly compressed together. Reference the Introduction to Fire Resistive Joint section of this directory for more details on how to determine the cut width of the

insulation to be installed in the joint width and how to determine the compressed percentage of a known insulation width installed in a known nominal joint. (** Listed with Omega Point Laboratories)

- B. Fill, Void or Cavity Material: Liquid is to be applied (sprayed, brushed, or trowled) to cover the exposed surface of the mineral wool installed in the perimeter joint. Apply a min. wet film thickness of 1/8 in. and overlap the material a min. 1/2 in. onto the adjacent curtain wall assembly and concrete floor slab assembly. If the spraying process is stopped and the applied liquid cures to an elastomeric film before process is

restarted, then overlap the edge of the cured material at least 1/8 in. with the spray. Reference Product Section of this Directory for more details about the Listed product.

Listed Manufacturer:

3M --

Joint Sealant

Spray

FireDam™ Spray 100

- ** Before testing, the spliced, test specimen was cycled 500 times at 30 cpm according to ASTM E 1399 and ICBO ES AC 30 (Jan. 1997).