


Design Number ENV/CWP 30-03
Non-Load Bearing Wall System
Envolution

Envolution Insulated Metal Panels and Envolution EVR Ribbed Roof Panel
CAN/ULC S 134 (1992)

Meets the Requirements of Section 3.1.5.5 of the National Building Code of Canada, 2010

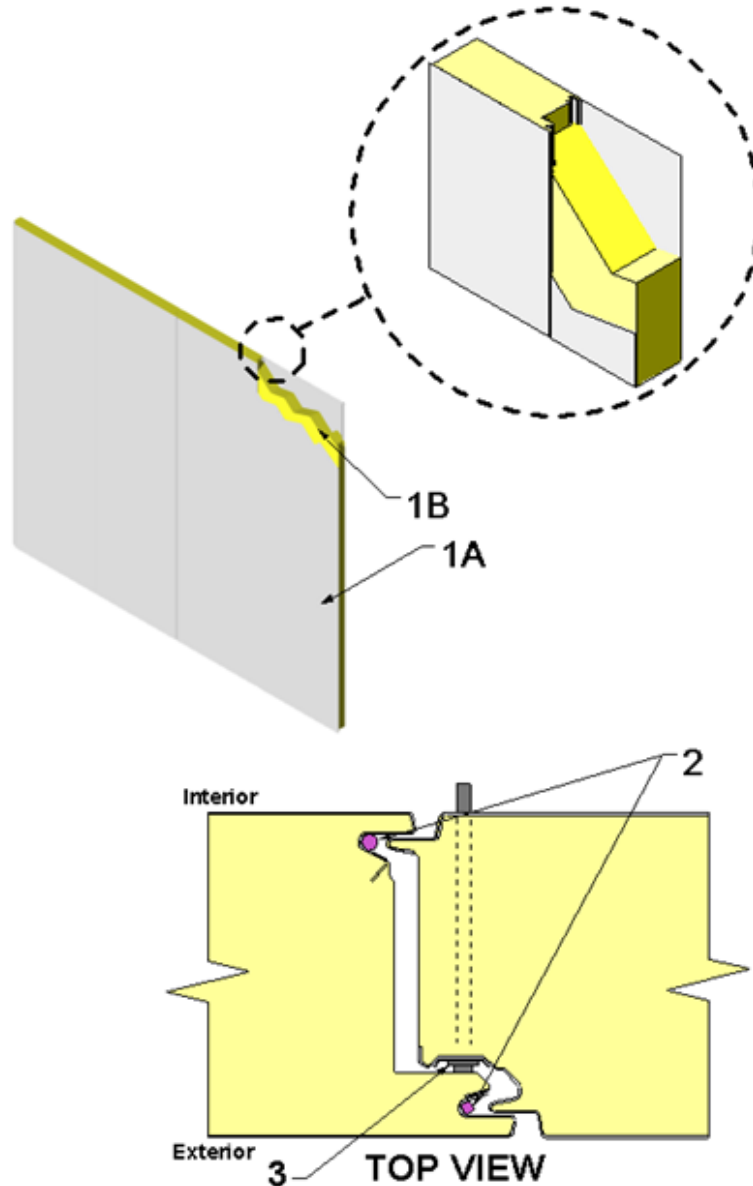

1. CERTIFIED COMPANY: Envolution.

CERTIFIED PRODUCT: Wall Panels

MODEL: Envolution Insulated Metal Panels
and Envolution EVR Ribbed Roof Panel (Not
Shown)

INSULATED WALL PANELS: Construct
wall of panels measuring nominal 12 to
44-1/2 in. wide. Min. thickness of the
Envolution Wall Panel is 2 in. and
Envolution EVR Ribbed Roof Panel is 1-
1/2 in. Max. approved thickness of 6 in.
Install panels with the longitudinal (long

Division 7 Thermal and Moisture Protection

07 42 00 Wall Panels

07 42 43 Composite Wall Panels

Page 2 of 2

dimension) edges placed horizontally or vertically. Construct wall panels of the following materials:

- A. Panel Facing – Construct interior and exterior faces of min. 26 GA galvanized or zinc/aluminum alloy coated steel with painted or mill finish, or min. 26 GA stainless steel with mill finish. Panel faces are roll formed with a smooth (no profile) or corrugated profile.
- B. Polyurethane Foam Core – Fill hollow core between panel faces (Item 1A) with nominal 2.17 pcf density polyurethane foam forming the male and female mating edges of the panels.

2. SIDE JOINT SEALANT – (Optional)

- A. Envolution Wall Panel - Install a nominal 3/16 in. bead of one component, urethane or butyl sealant to the female edge of the panel on either the exterior, interior, or both sides prior to joining the insulated wall panels (Item 1A).
- B. Envolution EVR Ribbed Roof Panel – Install a nominal 3/16 in. bead of one-component, urethane or butyl sealant to the female edge of the panel on the interior side prior to

joining the insulated wall panels (Item 1). Install butyl tape sealant for the exterior lap joint.

- 3. FASTENERS: Install fasteners according to panel type.
- C. Envolution Wall Panel - Install two (2) Number 14, or 1/4 in. diameter hex head screws through 7/8 in. wide X 4 in. long concealed panel clips within the side joints of the insulated wall panel (Item 1). The screws shall be of sufficient length so as to properly engage the wall support member. Install clips at each wall support member.
- D. Envolution EVR Ribbed Roof Panel: (Not Shown) Install Number 14, or 1/4 in. diameter x 7/8 in. Lap Tek screws at a min. of 20 in. on center (oc) through the panel overlap at the exterior side joint. Install #14 or 1/4 in. diameter screws through wall panel at 12 in. oc. between the major panel ribs to secure the panel to wall support member. The screws shall be of sufficient length so as to properly engage the wall support member. Fasteners shall be used at all wall support members.