


DESIGN NO. PS/PV 180-02
6" SELF SEAL STACK ASSEMBLY
F-RATING: 180 MINUTES; T-RATING: 178 MINUTES

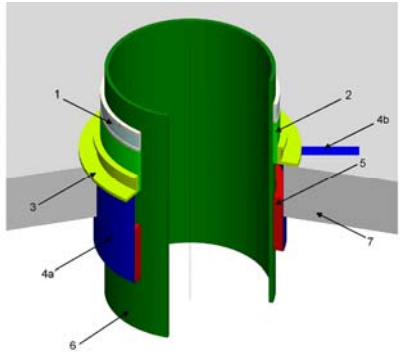

1. A06214-P 6" PVC riser clamp.
2. ProSet P-43 PVC pipe. PVC (Georgia Gulf) is constructed of Type 1 fire rated PVC resin.
3. ProSet P-43 PVC pipe predrilled fastening flange. PVC (Georgia Gulf) is constructed of Type 1 fire rated PVC resin.
4.
 - a) 26 gage (min. 0.0179" thick) sheet steel extension sleeve. Sleeve has diameter of 7-1/2". Extends a minimum 3" below bottom of concrete slab.
 - b) Two 26 gage sheet metal pre-drilled fastening tabs extend from top edge of metal extension sleeve outward on the upper surface of concrete slab (minimum 3" apart).
5. 3/4" x 4-1/2" Alva-Tech Intumescent wrap.
6. Schedule 40 DWV 6" PVC drain pipe.
7. Concrete slab minimum 4-1/2" thick and with a minimum compressive strength of 2800 psi.

Testing Standard(s): ASTM-E814