


DESIGN NO. PS/PH 120-17
HORIZONTAL (FLOOR); RATINGS: ASTM-E814 - 2 HOUR (F), 1 HOUR (T)
TEST PRESSURE DIFFERENTIAL - 2.5 Pa (0.01" OF WATER) MINIMUM

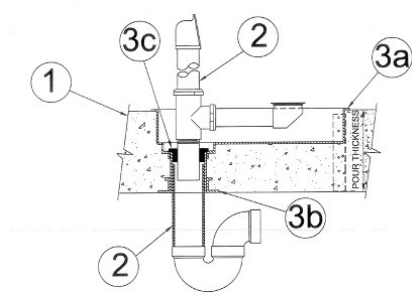

1	Floor: Minimum 7" thick normal density concrete slab.
2	Pipe Materials and Pipe Support: 1-1/2" tubular brass or PVC plastic waste & overflow pass through Pro-Seal Plug on top side. Vertical pipe & P-trap to be supported by solvent cementing the pipe into the embedded coupling.
3	Firestop System Components: a) ProSet P25620 F.R. PVC Tub Box* b) ProSet 2 in. P2543 PVC Sleeve Coupling* c) ProSet ProSeal Plug P-25662 or P-25661 on the top side for tube or pipe size waste & overflow.
	Note: See Design No. PS/PH 120-11 for slabs less than 7".

*Components bearing the Warnock Hersey Certification Mark.