


DESIGN NO. PS/PH 120-11
HORIZONTAL (FLOOR), RATINGS: ASTM-E814 - 2 HRS (F), 1 HR. (T)
TEST PRESSURE DIFFERENTIAL - 2.5 Pa (0.01" OF WATER) MINIMUM

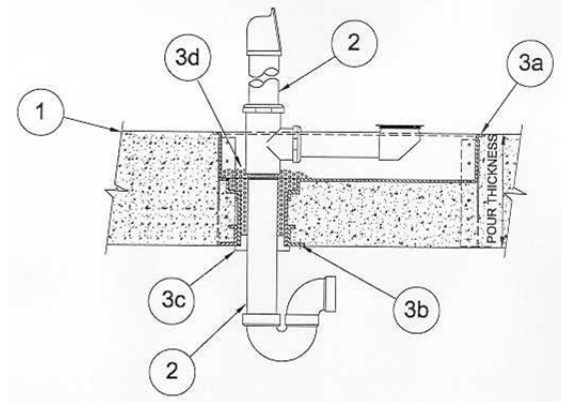

1	Floor: Minimum 4-1/2" thick normal density concrete slab.
2	Pipe Materials & Pipe Support: 1-1/2" tubular Brass or PVC Plastic Waste & Overflow pass through pipe. P-Trap & branch pipe to be reliably supported.
3	Firestop System Component: a) ProSet P25620 FR PVC Tub Box*. b) ProSet 2" P2543 PVC Sleeve Coupling*. c) ProSet ProSeal Plug P-20112 or P-25661 at tub bottom for pipe or tube size waste & overflow. d) ProSet Firefill* material must be used to fill the void between the pass through pipe and the sleeve to a minimum 4" depth. The 4" depth cannot be obtained inside the sleeve Coupling, additional Firefill must be installed up to the tub box itself in order to obtain a minimum 4" material depth. When the floor is 7" or more in depth, the ProSeal Plug can be installed on the top side of the tub box without any Firefill.

*Components bearing the Warnock Hersey Certification Mark.