

**IPEX Inc. - Verdun, PQ, Canada**  
**DESIGN NO. IXI/PH 120-01**


**HORIZONTAL (FLOOR)**

**RATINGS – See Below**

**Hole Size – See Item 3**

**TEST PRESSURE DIFFERENTIAL – 50 Pa (0.20 in. of water)**

Penetrant	Maximum Pipe ID	ULC-S115-95 CAN4-S115-M F, FH, FT, FTH
PVC	3"	2 HR
ccABS	3"	2 HR
ABS	3"	2 HR

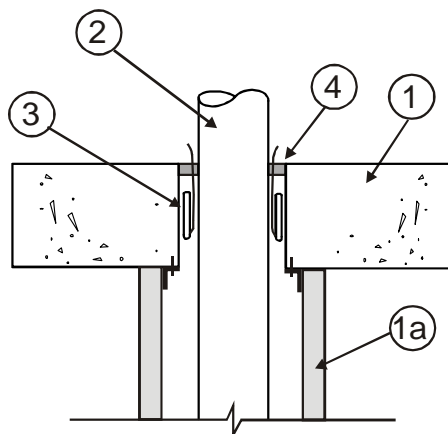

1. **Floor Assembly** - Code conforming 2 HR rated floor assembly, nominal 4-1/2 " thickness, normal or low density cast concrete.
- 1a. **Wall Assembly** - Gypsum wallboard assembly, constructed with rated or nonrated wallboard, nominal 3-1/2" deep steel studs. Steel ceiling track is secured to the underside of the floor assembly.
2. **Penetrant** - (See also table of ratings) Nominal 3" diameter or smaller, sch. 40, ccABS, ABS and PVC pipes for DWV or Closed (Process & Supply) plumbing applications, Penetrants must be contained within a wall assembly, ratings achieved will equal that of floor assembly.

**Firestop System Components:**

3. **\*IPEX Firepro™ System 2** : Install within opening, recessed 1-1/4" from either surface, according to the manufacturers instructions. To reduce opening size use **\* 3M™ Fire Barrier Mortar** or non-shrink grout.

Pipe ID	Hole Diameter
1-1/2"	2-1/2" to 3"
2"	3" to 3-1/2"
3"	4-1/2" to 5"

4. **Sealant** - **\* 3M™ CP-25WB+ Caulk** or **\*3M™ FireDam™ FD-150+ Caulk**, applied to 1/2" thickness flush with the floor surface.

**Note:** metric conversion factor, inches x 25.4 = mm

**\*Component bearing the Warnock Hersey Certification Mark**