


HORIZONTAL or VERTICAL (FLOOR or WALL)
RATINGS - See Below
HOLE SIZE - See Item 3
TEST PRESSURE DIFFERENTIAL - 2.5 Pa (0.01 in. of water)

Design conforms to NBC 1995, reference clause 3) of 3.1.5.15 “Combustible Piping Materials”.

| Penetrant | Design | Maximum Pipe ID | ULC-S115-95 CAN4-S115-M F& FH, FT& FTH |
|-----------|--------|-----------------|--|
| FRPP | A | 3" | 2 HR |
| FRPP | B | 3" | 2 HR |
| FRPP | C | 3" | 1 HR |
| FRPP | C | 3" | 2 HR |

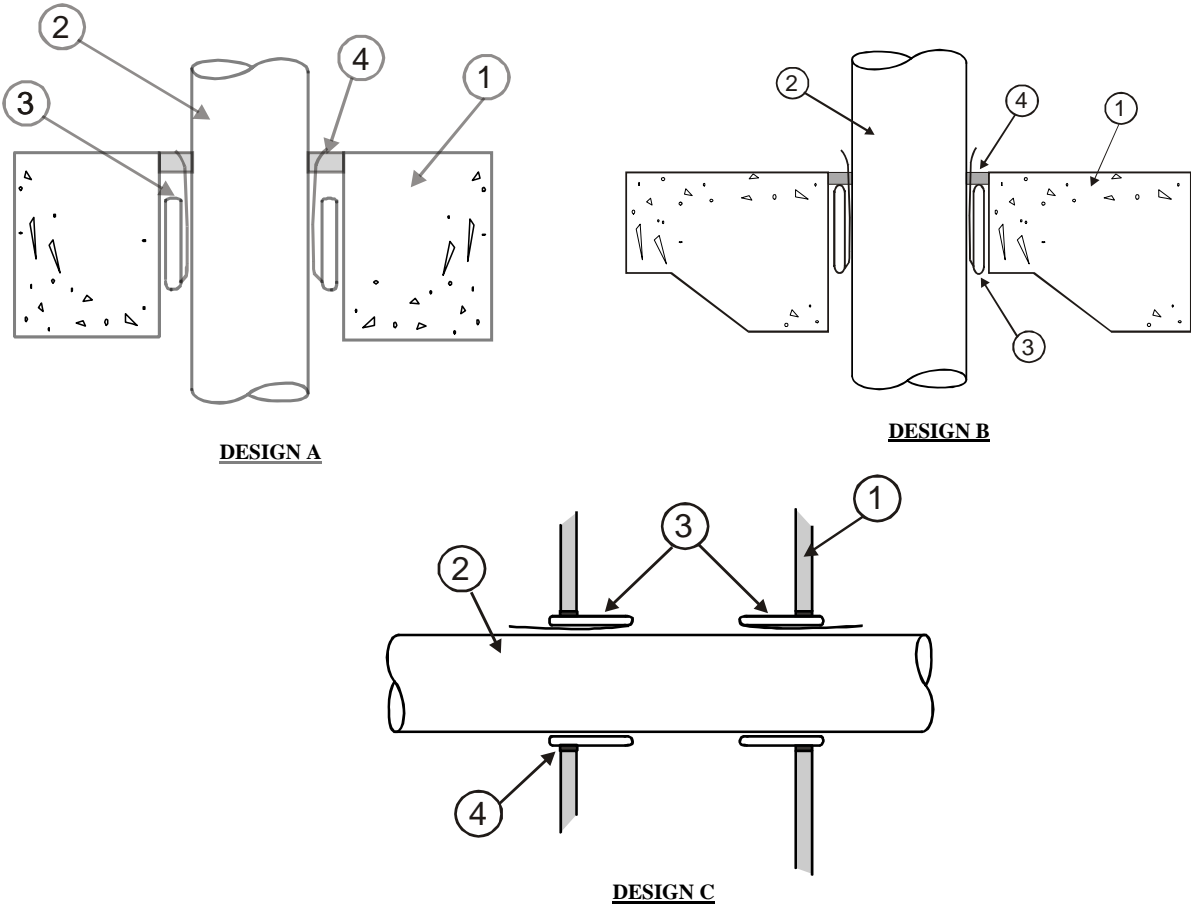

1. **Floor or Wall Assembly:**

Design A: Code conforming 2 HR rated floor or wall assembly, nominal 4-1/2 " thick, normal or low density cast concrete or hollow core concrete. Wall may also be constructed of nominal 8" thick concrete blocks (filled or unfilled).

Design B: Code conforming 2 HR rated floor assembly, nominal 2-1/2" thick, Q Deck or Fluted Deck, normal or low density cast concrete.

Design C: Code conforming 1 or 2 HR fire-rated gypsum wallboard assembly, nominal 2" x 4" steel/wood framed gypsum wallboard, wall assembly.

2. **Penetrant :** (See also table of ratings) - Schedule 40, FRPP (Fire-Rated Polypropylene Pipe), ratings achieved will equal that of floor or wall assembly.

3. **Firestop System Components:**

Design A: *IPEX Firepro™ System 2- Install within opening, recessed 1-1/4" from either surface, according to the manufacturers instructions. For walls apply firestop system to both sides. To reduce opening size use *3M™ Fire Barrier Mortar or non-shrink grout. Firestop is installed on both sides of the wall.

Design B: *IPEX Firepro™ System 2- Install within opening 1/2" below the floor surface of the concrete according to the manufacturers instructions.

Design C: *IPEX Firepro™ System 2- Install with 1/4" of the firestop exposed outside the surface of the gypsum wall assembly according to the manufacturers instructions. Firestop is installed on both sides of the wall.

| Pipe ID | Hole Size |
|---------|-----------|
| 1-1/2" | 2-1/2" |
| 2" | 3" |
| 3" | 4-1/2" |

4. **Sealant** - *3M™ CP-25WB+ Caulk to fill the annular space at the pipe penetration as a smoke seal.

Note: metric conversion factor, inches x 25.4 = mm

*Component bearing the Warnock Hersey Certification Mark