

Grabber Construction Products, Inc. Design No. JWA/PH 120-05


Horizontal Floor/Ceiling Assembly, Single Penetrations GrabberGard EFC and GrabberGard IFC

Test Standards: ASTM E814, UL 1479: Non-metallic Open and Closed Systems

ULC S115**: Non-metallic Closed Systems

Test Furnace Internal Positive Pressure Differential – 2.5 Pa (0.01 in. of water) Minimum
Rating: 2 Hour

Penetrating Material & Size	Max Hole Size	Annular Space	Fire "F" Rating	Temp Rating "T" Rating
PVC Plastic Pipe 1-1/2" – 4"	5"	0" – 1/2"	Up to 2 Hr	Up to 2 Hr
ccPVC Plastic Pipe 1-1/2" – 4"	5"	0" – 1/2"	Up to 2 Hr	Up to 2 Hr
CPVC Plastic Pipe 1-1/2" - 4"	5"	0" – 1/2"	Up to 2 Hr	Up to 2 Hr
ccABS Plastic Pipe 1-1/2" - 4"	5"	0" - 1/2"	Up to 2 Hr	Up to 2 Hr
ABS Plastic Pipe 1-1/2" - 4"	5"	0" - 1/2"	Up to 2 Hr	Up to 2 Hr
FRPP Plastic Pipe 1-1/2" - 4"	5"	0" - 1/2"	Up to 2 Hr	Up to 2 Hr

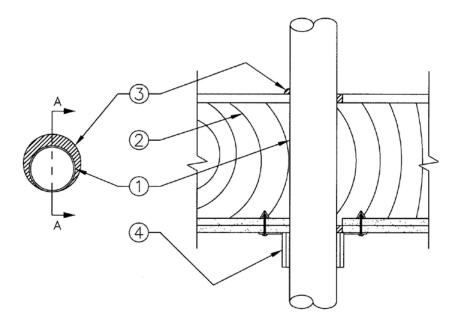

- **1. PENETRATING ITEM:** Centered or offset in hole, see table above. Single penetrations only, max. hole size not to exceed table above.
- 2. FLOOR/CEILING ASSEMBLY: 1 or 2 hour rated ASTM E-119 wood framed gypsum wallboard (GWB) floor/ceiling assemblies with or without concrete topping, min. nominal 10 in. depth wood or composite wood floor joists.
- 3. FIRESTOP SYSTEM, COMPONENT 1: Grabber Construction Products, Inc. GrabberGard EFC* or GrabberGard IFC* installed at a min. thickness of 3/4 in. (19mm) within the annulus on top surface of floor assembly, and a min. of 5/8 in. (18mm) within the annulus of the gypsum wallboard ceiling membrane. On 0 in. to 1/4 in. (6mm) annular spaces of the floor surface, a 1/2 in. (13mm) diameter fillet bead must be placed around the penetrating item.

Date Revised: August 8, 2018 Page 1 of 2 Project No. 491-8009



Division 07 – Thermal and Moisture Protection 07 84 00 Firestopping 07 84 13 Penetration Firestopping

- 4. FIRESTOP SYSTEM, COMPONENT 2: PFP Partner Plastic Pipe Collar* (PPC) specifically sized for diameter of pipe. PPC secured to floor/ceiling assembly using 1-1/2 in. toggle bolts over fender washers, at joist locations use 1-1/2 in. drywall screws to fasten collar directly to joists.
- *WH Labeled Component
- ** Not tested to 50 Pa pressure differential as required by Canadian code for combustible DWV (Drain, Waste or Vent) piping systems.

Version: 02 August 2017 SFT-BC-OP-19i