
Vellrath Engineering
Design No. VEL/CF 120-01
Cementitious Coating
Universal Fireproofing Patch
ASTM E119
Rating: 2 hour

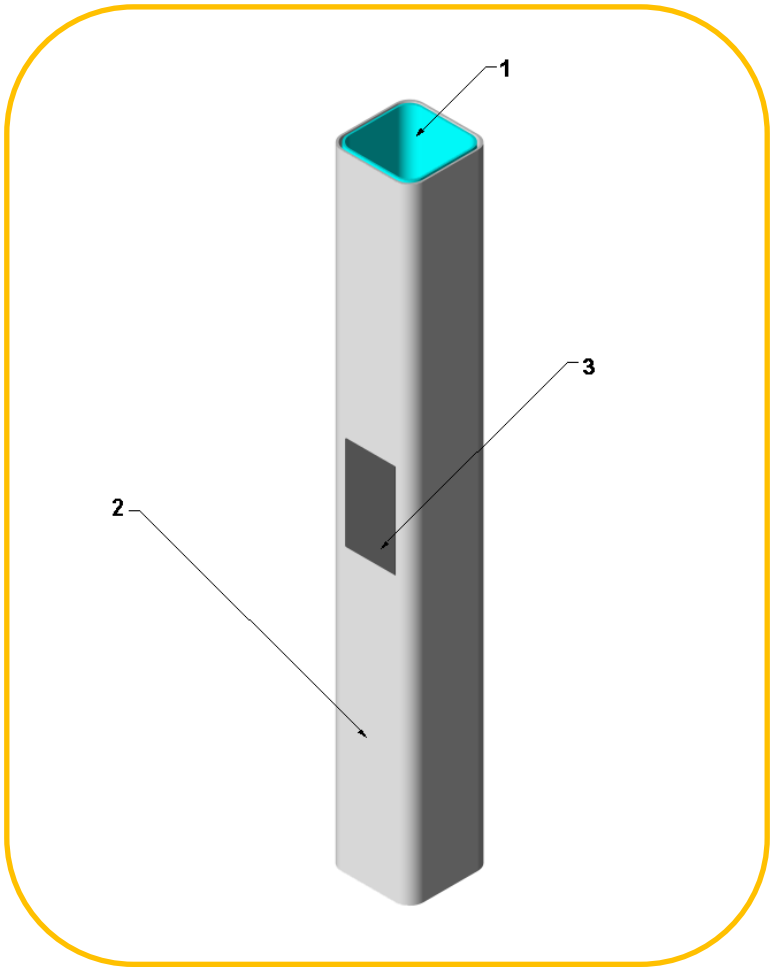

1. **STRUCTURAL STEEL MEMBER:** Structural steel member, (column, beam, joist, girt or corrugated steel decking) placed in the field which currently has cementitious spray applied fire protective materials (Item 2) applied to the structural steel member.

2. **CEMENTITIOUS SPRAY APPLIED FIRE PROTECTIVE MATERIAL:** Cementitious spray applied fire protective material applied to a structural steel member (Item 1) at some prior date in accordance with manufacture specifications and in compliance with corresponding certifications for the specific member and rating, up to 2 hours.

3. **CERTIFIED MANUFACTURER:** Vellrath Engineering

   CERTIFIED PRODUCT: Cementitious Fireproofing

   CERTIFIED MODEL: Universal Fireproofing Patch

   Apply cementitious fireproofing patch per manufactures directions to an area, up to 3 square feet, of the structural steel member (Item 1) that has had the cementitious spray applied fire protective material (item 2) removed or damaged. Apply the cementitious fireproofing patch to a thickness equivalent to that of the current cementitious spray applied fire protective material (Item 2).