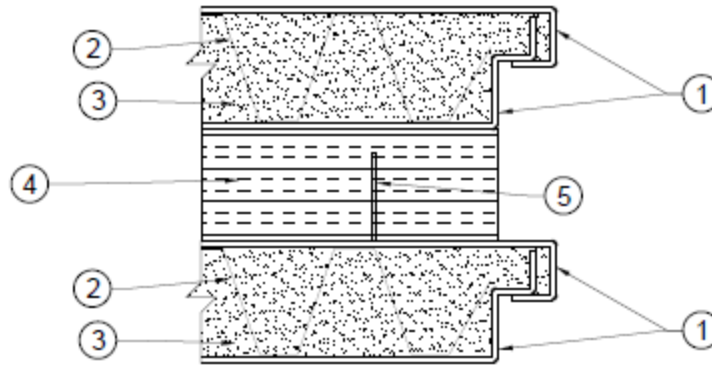

Trussbilt LLC
Design No. TBL/MWP 120-03
Fire Rated Trusswall Panel
ASTM E119, CAN/ULC S101, UL 263
Rating: 2 Hour, Non-load Bearing



CERTIFIED MANUFACTURER: Trussbilt LLC

CERTIFIED PRODUCT: Fire Rated Wall Panel

CERTIFIED MODEL: Trusswall

COMPONENTS:

1. 12 GA steel outer skins; ASTM A1011A/A1011M Mild Steel, ASTM A653A/A653M Galvanized Steel, or ASTM A240/A240M 409 Series Stainless Steel. Panels secured together by 2 in. welds 12 in. on center (oc) at joints.

2. 28 GA steel continuous W-channel inner stiffener.
3. CMX foam concrete density 30 (±2) pcf.
4. Rockwool insulation min. density 6 pcf.
5. Insulation support pins, 1-1/2 in. long, 24 in. oc in field.