


Trussbilt Manufacturing FR3 Trusswall Stacking Detail Detail No. M33

Investigated by Intertek for compliance with applicable requirements. For use with
Trussbilt's Fire Rated Wall Panel System TBM/MWP 180-01
For use with non-bearing wall installations.

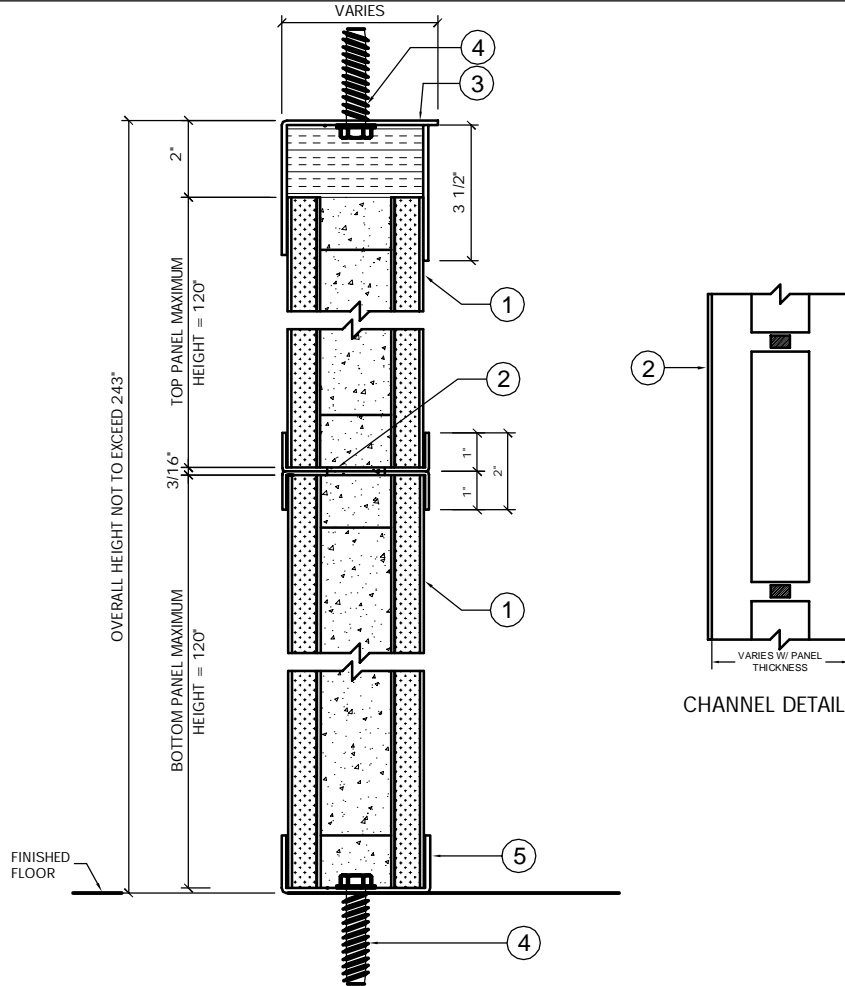

1. Trussbilt fire rated wall panel TBM/MWP 180-01 (3 hour rating)
2. 12 gauge minimum galv. channel w/ grout slots. (2) channels spot or plug welded together, maximum 6-1/2" O.C., to form "H" channel. Welded to panels per manufacturer's instructions.
3. Panel to ceiling attachment may vary.
4. 1/2" x 2-1/2" min. concrete anchor, 18" maximum O.C.
5. Floor channel welded to panel per manufacturer's instructions. Refer to detail B31.