


---

## Trussbilt Manufacturing End of Wall Joint Detail

### Detail No. E34

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBM/MWP 180-01

---

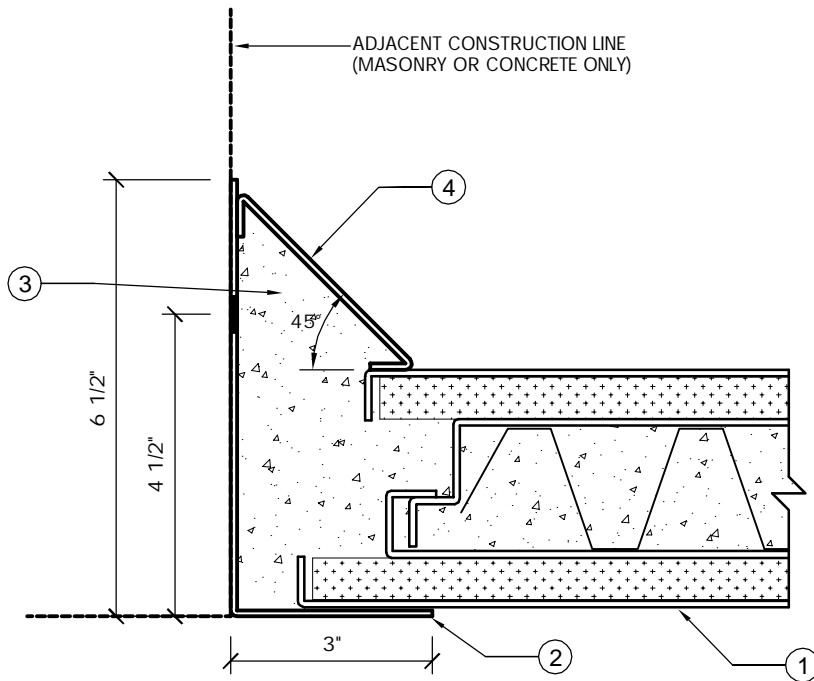

1. Trussbilt fire rated wall panel TBM/MWP 180-01 (3 hour rating)
  2. 12 gauge (minimum) A60 or 409SS wall channel:
    - Concrete / Masonry Substrate: prepared with holes for 3/8" (minimum) diameter mechanical anchors at 18" o.c. (maximum)
  3. Cavity between end of wall panel and trim piece to be filled with concrete or rockwool insulation (4 PCF compressed 50% minimum).
  4. 12 gauge (minimum) A60 or 409SS wall closure plate welded to wall panel and wall channel.
-