


## Trussbilt, LLC Top of Wall Joint Detail Detail No. T24

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBL/MWP 120-02. For use with non-bearing wall installations.

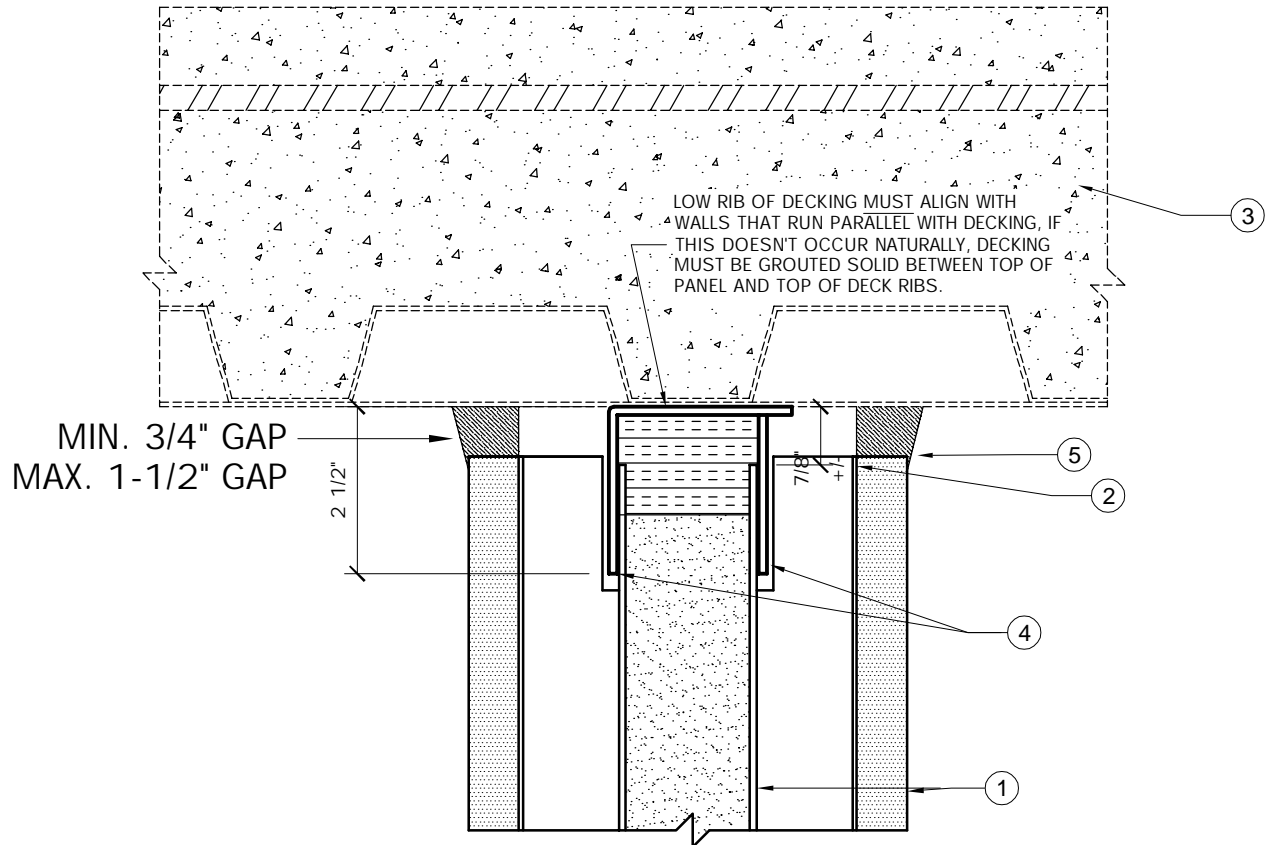

1. Trussbilt fire rated wall panel TBL/MWP 120-02 (2 hour rating)
2. Cavity between end of wall panel assembly and trim channel to be filled with concrete or rockwool insulation (4 PCF compressed 50% minimum).
3. Flat bottom fire rated concrete on fluted metal deck assembly.
4. 12 gauge (minimum) A60 or 409SS channel/plate secured to wall panel and decking per manufacturer's details.
5. Fill gap with Hilti Firestop sealant CP606 or Hilti Firestop sealant FS-One.