


## Trussbilt, LLC Bottom of Wall Joint Detail

### Detail No. B21

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBL/MWP 120-02.

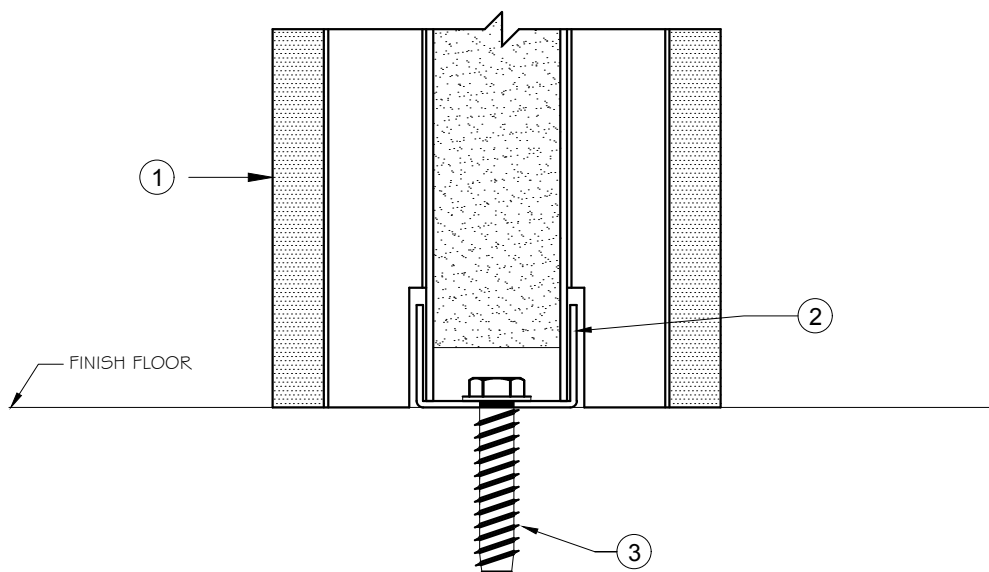

1. Trussbilt fire rated wall panel TBL/MWP 120-02 (2 hour rating)
2. 12 gauge (minimum) A60, 409SS or 304SS floor channel with holes pre-punched for anchors as required.
3. 3/8" minimum diameter wedge bolt anchors located at 18" o.c maximum.