


Trussbilt, LLC Frame Installation Detail

Detail No. F41

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBL/MWP 120-04.
For non-bearing wall installations.

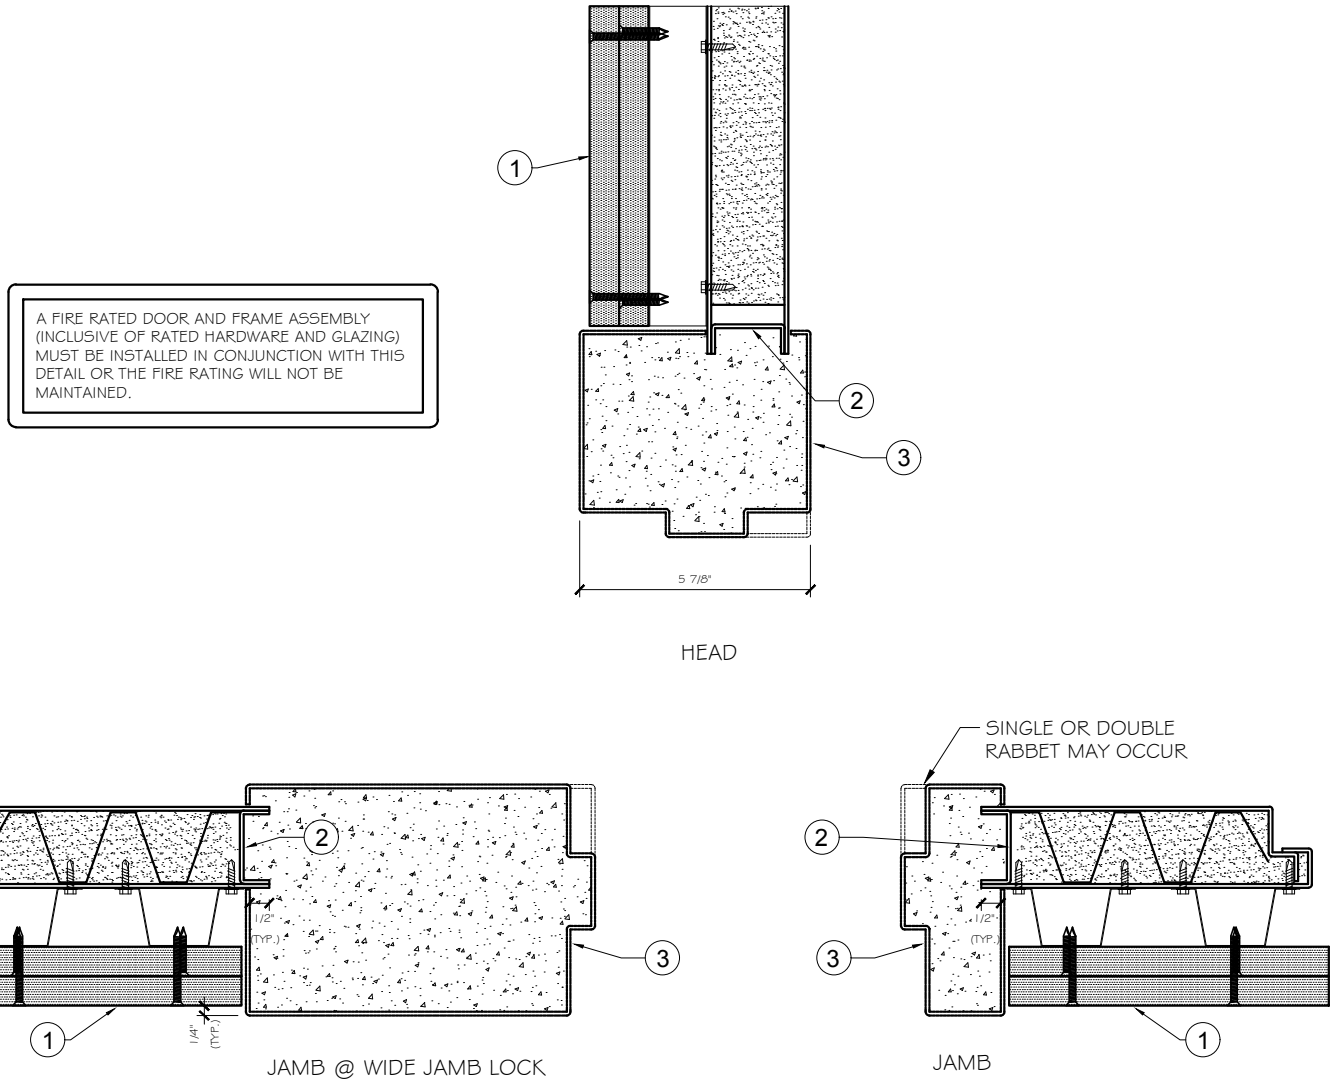

1. Trussbilt fire rated wall panel TBM/MWP 120-04 (2 hour rating)
2. 12 gauge minimum galv. channel. Spot or plug welded in place.
3. Fire rated frame and door assembly welded to fire rated wall panel per manufacturers instructions. Frame to be grouted.