


Trussbilt, LLC FR Trusswall Stacking Detail Detail No. M42

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBL/MWP 120-04. For use with non-bearing wall installations.

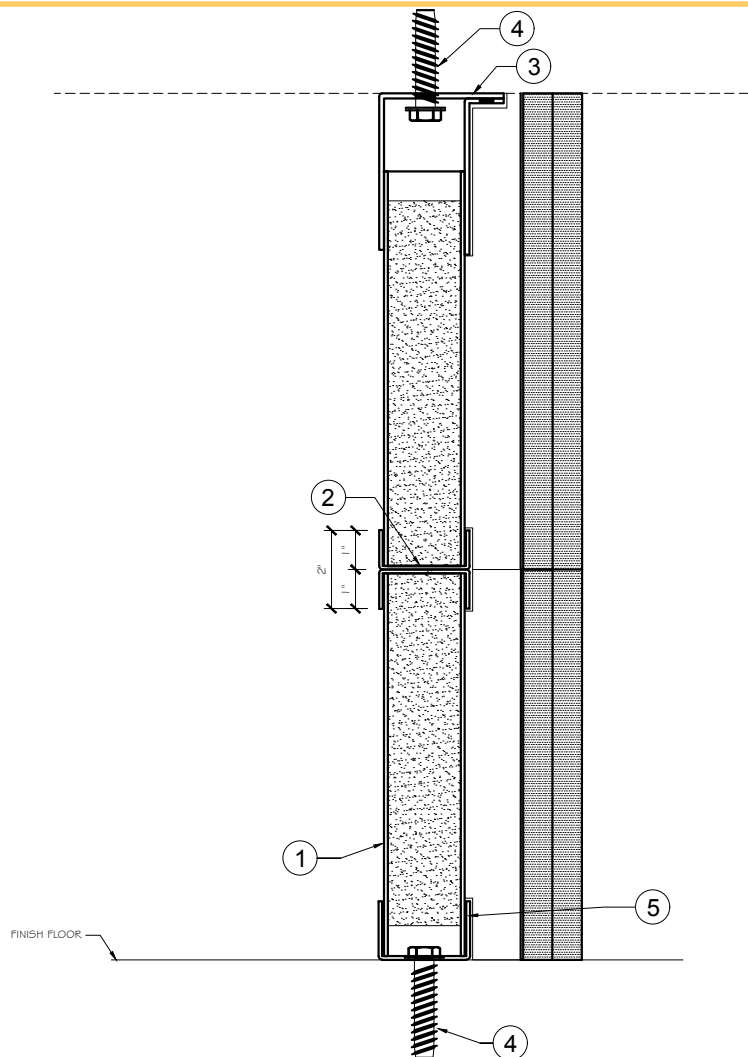

1. Trussbilt fire rated wall panel TBL/MWP 120-04 (2 hour rating).
2. 12 gauge minimum galv. channel. (2) channels spot or plug welded together, maximum 6-1/2" O.C., to form "H" channel. Welded to panels per manufacturer's instructions.
3. Panel to ceiling attachment may vary.
4. 1/2" x 2-1/2" min. concrete anchor, 18" maximum O.C.
5. 12 gauge (minimum) A60, 409SS or 304SS floor channel with holes pre-punched for anchors as required. Refer to detail B41 or B42.