


Trussbilt, LLC Top of Wall Joint Detail

Detail No. T41

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBL/MWP 120-04. For use with non-bearing wall installations.

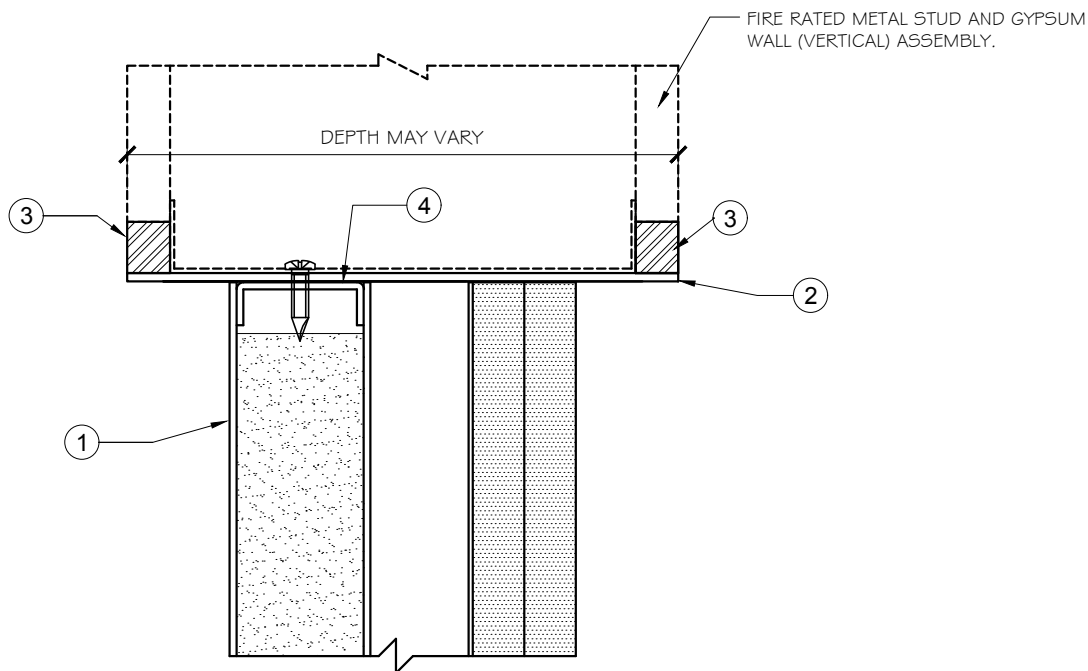

1. Trussbilt fire rated wall panel TBL/MWP 120-04 (2 hour rating)
2. 12 gauge (minimum) A60 or 409SS plate, plugwelded or spotwelded to channel @ 18" O.C. maximum, or secure with 1/4" diameter Tek screws @ 6" O.C. maximum.
3. 5/8" (minimum) thickness Hilti Firestop sealant CP606 or Hilti Firestop FS-One sealant.
4. 12 gauge A60 or 409SS channel.