


Trussbilt, LLC Top of Wall Joint Detail Detail No. T42

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBL/MWP 120-04. For use with non-bearing wall installations.

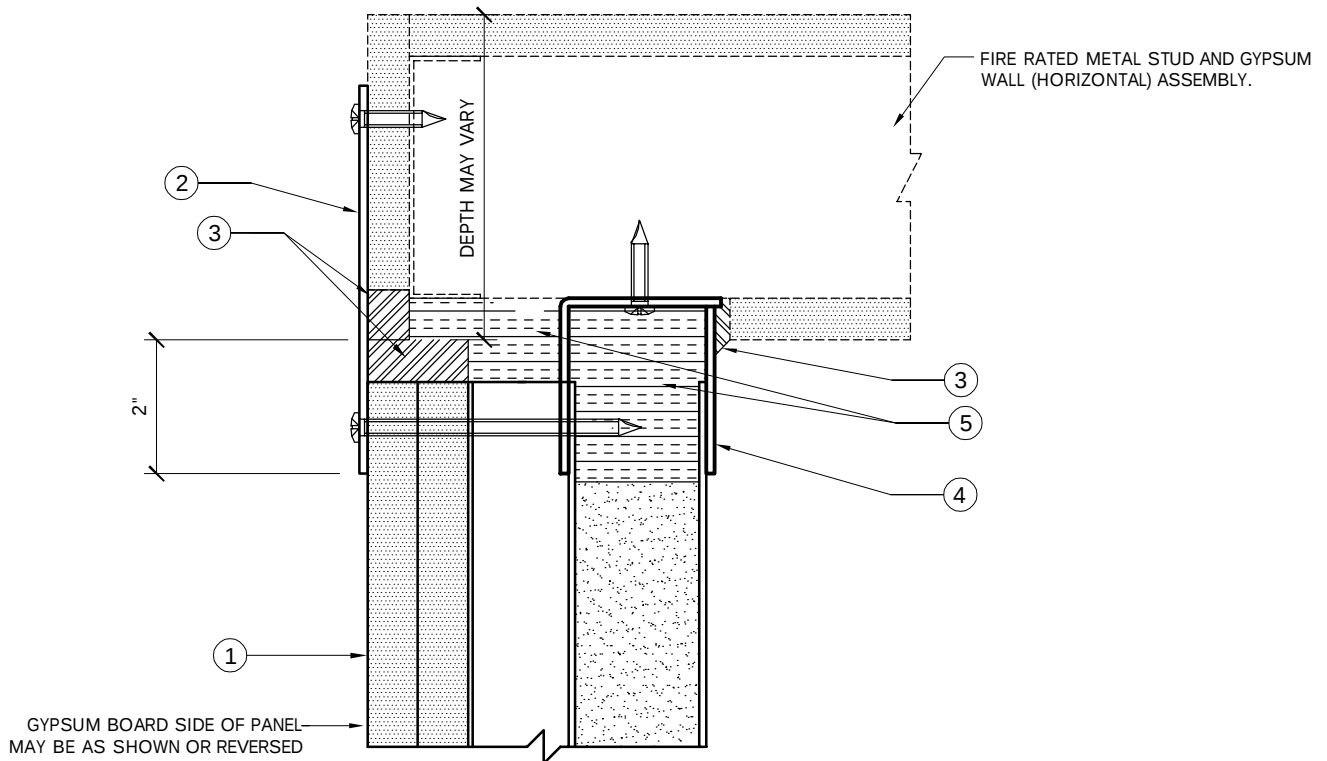

1. Trussbilt fire rated wall panel TBL/MWP 120-04 (2 hour rating)
2. 12 gauge (minimum) A60 or 409SS plate secured with 1/4" diameter Tek screws @ 6" O.C. maximum.
3. 3/4" (minimum) thickness Hilti Firestop sealant CP606 or Hilti Firestop FS-One sealant.
4. 12 gauge (minimum) A60 or 409SS channel and closure plate secured to metal studs.
5. Cavity between end of wall panel and trim piece to be filled with concrete or rockwool insulation (4 PCF compressed 50% minimum).