


3M Company
Design No. 3MU/JS 180-05
Perimeter Fire Barriers
ASTM E2307 / ASTM E1399 / UL 2079 / CAN/ULC-S115

	FireDam™ Spray 200, Fire Barrier Watertight Spray, Fire and Water Barrier Tape FWBT, Fire Barrier 1000 NS Silicone Sealant, and Fire Barrier 1003 SL Silicone Sealant	
	50% Compression	33% Compression
F-Rating	3 Hr	3 Hr
T-Rating	2-1/2 Hr	1-1/2 Hr
L-Rating (UL 2079)	<1.0 SCFM/LF	<1.0 SCFM/LF
Cycling (%)	Class IV: 500 cycles @ 30 cpm	Class IV: 500 cycles @ 30 cpm
Horizontal	± 16.7	± 11
Vertical	± 6.25	

±: Fire Barrier Watertight Spray cycling rating limited to ±10% horizontal movement



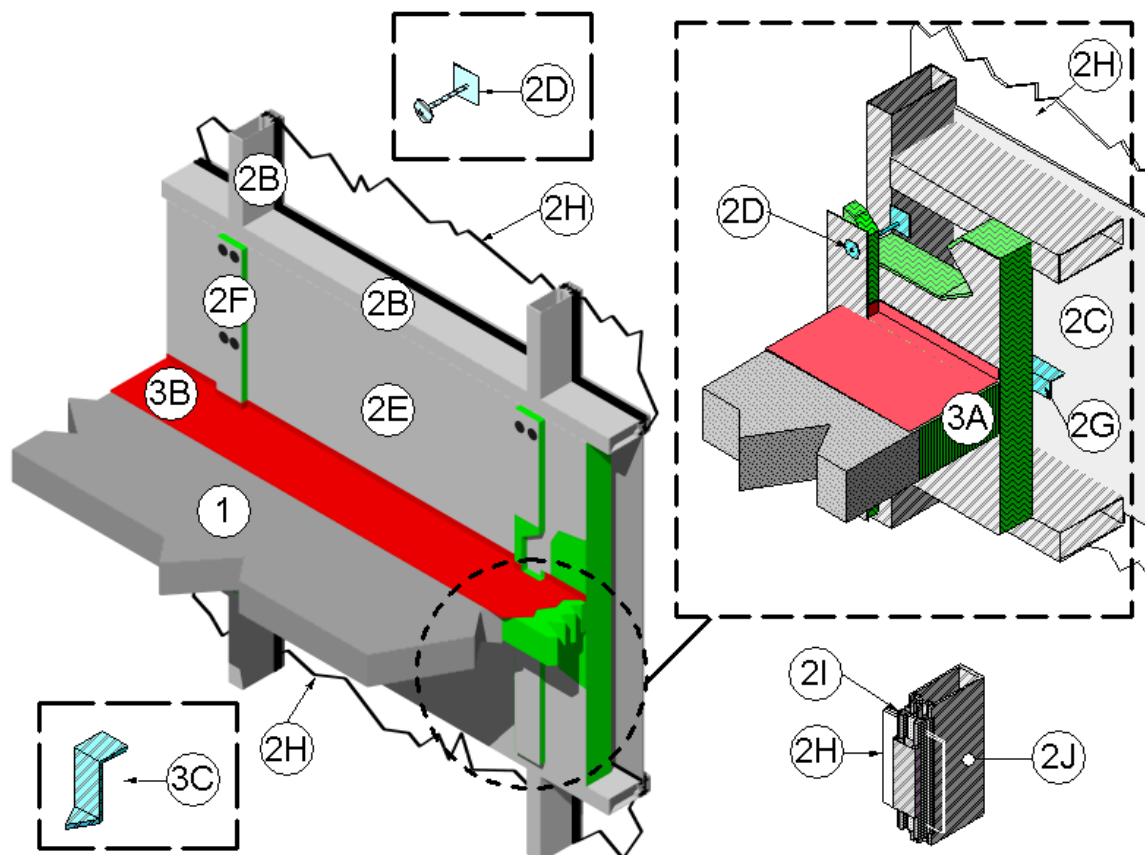

1. **CONCRETE FLOOR ASSEMBLY:** 3 hour rated concrete floor assembly made from either lightweight or normal weight concrete with a density of 100 to 150 pcf, having a min. thickness of 4-1/2 in. at the joint face. When a longitudinal recess (blockout) is required to contain an architectural joint system, increase concrete floor assembly thickness to maintain a min. thickness of 4-1/2 in. and accommodate depth of blockout formed in the concrete: blockout width unrestricted.
2. **CURTAIN WALL ASSEMBLY:** Incorporate the following construction features:
 - A. **MOUNTING ATTACHMENT – (Not Shown)** Attach aluminum framing (Item 2B) to the structural framing according to the curtain wall manufacturer's instructions. When required, connect the mounting attachments to the joint face of the concrete floor assembly (Item 1) according to the curtain wall manufacturer's instructions. Limit distance between mounting attachments to max. 120 in.
 - B. **ALUMINUM FRAMING –** Use hollow rectangular aluminum extruded tubing with min. overall dimensions of 0.100 in. thick, 5-1/2 in. high, and 2-1/2 in. wide. Locate mullions (vertical aluminum framing) min. 60 in. on center (oc) and locate transoms (horizontal aluminum framing) a min. 10 in. oc. For the spandrel region, locate the upper transom flush with the concrete floor assembly (Item 1) as measured from the top surface of the concrete floor assembly (Item 1) to the underside of the transom.
 - C. **ALUMINUM PANELS –** Install min. 1/8 in. thick aluminum panels with min. dimensions of 10 in. × 60 in. to aluminum framing (Item 2B) according to the curtain wall system manufacturer's guidelines.
 - D. **IMPALING PINS –** Use with curtain wall insulation (Item 2E) and framing covers (Item 2F), locate, size, and install impaling pins according to the curtain wall system manufacturer's guidelines, or be a min. 4-1/2 in. long, 12 GA pin attached to one of the following: a nominal 2 in. × 2 in. plate; a nominal 2 in. × 2 in. × 2 in. long angle; or can be directly attached to the aluminum framing (Item 2B) using a stud gun. Space impaling pins a max. of 12 in. oc vertically and 20 in. oc horizontally. Install impaling pins around the periphery of the curtain wall insulation (Item 2E) so that its interior face is flush with the interior face of the aluminum framing (Item 2B).
 - E. **CURTAIN WALL INSULATION –** Use nominal 24 in. wide, 4 in. thick 4 pcf density, 3 in. thick 6 pcf density, or 2 in. thick 8 pcf density, mineral wool batt insulation faced on one side with aluminum foil scrim (vapor retarder), which is exposed to the room interior and installed in the stud cavity. Install curtain wall insulation between aluminum framing (Item 2B). Secure curtain wall insulation with clips or impaling pins. Seal all meeting edges of curtain wall insulation with nominal 4 in. wide pressure sensitive aluminum foil-faced tape (not shown) centered over the junction so that approximately 2 in. of tape covers each edge of the adjacent curtain wall insulation. Apply pressure sensitive aluminum foil-faced tape over all meeting edges of curtain wall insulation and framing covers (Item 2F), so that approximately 2 in. covers each edge of the adjacent material. Install curtain wall insulation flush with the interior face of the aluminum



framing (Item 2B). Install 24 in. wide curtain wall insulation without vertical seams, spanning the full length between aluminum framing (Item 2B). Locate horizontal seams in the curtain wall insulation at least 6 in. from the top surface of the perimeter joint protection (Item 3). Maintain 1-1/4 in. air cavity between curtain wall insulation and aluminum panels (Item 2C). Option: In lieu of filling the full depth of the stud cavity with 4 in. thick, 4 pcf density curtain wall insulation, use min. 2 in. thick 8 pcf density curtain wall insulation mechanically secured (do not secure by friction fit) and use additional horizontal support angle (not shown). Locate a horizontal support angle consisting of a min. 20 GA steel angle, having 1-1/2 in. x 1-1/2 in. legs horizontally at the mid-height of the packing material (Item 3A), and attached to each mullion of aluminum framing (Item 2B) using min. No. 6, 1/2 in. long self-tapping sheet metal screws. Use only Intertek certified products meeting the above min. requirements.

- F. FRAMING COVERS – Make from strips of min. 1 in. thick x min. 4 in. wide, 8 pcf density, mineral wool batt insulation faced on one side with aluminum foil scrim (vapor retarder), which is exposed to the room interior. Center framing covers over all aluminum framing (Item 2B) and secure using impaling pins (Item 2D). Do not pass framing covers through the perimeter joint protection (Item 3). Allow framing covers to abut top and bottom surfaces of the perimeter joint protection (Item 3) provided that no deformation occurs. Use only Intertek certified products meeting the above min. requirements.
- G. REINFORCING ANGLE – Mount a min. 1-1/2 x 1-1/2 in., 20 GA galvanized steel

angle to the aluminum mullions (Item 2B), so that the vertical leg serves as a backer to the exterior face of the curtain wall insulation (Item 2E) and the horizontal leg extends away from the curtain wall insulation and is located at the centerline of the packing material (Item 3A). Size the angle 8 in. longer than the span between the interior edges of the aluminum mullions (Item 2B) and form the angle so that it has a 4 in. vertical leg on each end. Secure the 4 in. vertical leg on each end to the steel stud framing (Item 2B) on each side with three No. 10, steel self-tapping sheet metal screws placed in a triangular fashion with a max. spacing of 2 in. oc.

- H. GLASS VISION PANELS – When required, use optional glass vision panels flush with the top of the floor assembly (Item 1). Install glass vision panels to curtain wall framing according to the curtain wall system manufacturer's guidelines. Use a min. 1/4 in. thick, clear tempered glass with a nominal width and height as determined by the framing.
- I. WINDOW GASKETS – When optional glass vision panels are used, secure glass vision panels with a thermal break (thermo-set rubber extrusion).
- J. WINDOW FRAMING – Use tubing mullions and transoms, sized according to the curtain wall system manufacturer's guidelines. Min. required framing dimensions, use 0.100 in. thick walls with min. 5-1/2 in. depth and min. 2-1/2 in. width, and window framing must be compatible with steel framing (Item 2B). Locate window framing flush with the top surface of the floor assembly.



3. PERIMETER JOINT PROTECTION: Do not exceed an 8 in. nominal joint width (joint width at installation). Incorporate the following construction features for the perimeter joint protection (also known as perimeter fire barrier system):

A. **PACKING MATERIAL** – Use a min. 4 in. thick, 4 pcf density, mineral wool batt insulation installed with the fibers running parallel to the edge of concrete floor assembly (Item 1) and curtain wall assembly (Item 2). Cut packing material width to achieve required compression, refer below, when installed in the nominal joint width. Compress the packing material into the perimeter joint. Tightly compress together splices (butt joints) in the lengths of packing material by using min. 1/4 in. compression per piece of packing material. Use only Intertek certified products meeting the above min. requirements. When a spray coating or tape is used, locate the top surface of the packing material flush with the top surface of the concrete floor assembly (Item 1). When the non-sag or self-leveling silicone sealant is used, recess the top surface of the packing material 1/4 in. from the top surface of the concrete floor assembly (Item 1).

- i. When 50% compression is required, cut the width of the packing material 2 times wider than the nominal joint width.
- ii. When 33% compression is required, cut the width of the packing material 1-1/2 times wider than the nominal joint width.

B. **CERTIFIED MANUFACTURER** – 3M Company

CERTIFIED PRODUCT – FireDam™ or Fire Barrier™

MODEL – FD Spray 200 (Elastomeric, Sprayable), Fire Barrier Watertight Spray (Elastomeric, Sprayable), or Fire and Water Barrier Tape FWBT (Tape) or FB 1000 N/S Silicone Sealant (Non-sag) or FB 1003 S/L (Self-leveling)

FILL, VOID, OR CAVITY MATERIAL – Apply either spray coating or sealant over the packing material (Item 3A) as follows:

SPRAY COATING – Spray the liquid to cover the exposed top surface of the packing material (Item 3A), compressed and installed in the perimeter joint. Apply a min. wet film thickness of 1/8 in. FireDam Spray 200 or 1/10 in. Fire Barrier Watertight Spray and overlap the spray coating a min. 1/2 in. onto the adjacent curtain wall assembly (Item 2) and concrete floor assembly (Item 1). When the spraying process is stopped and the applied spray coating cures to an elastomeric film before installation process is restarted, then overlap the edge of the cured spray coating at least 1/8 in. with the liquid spray coating.

TAPE – Apply the tape such that there is a min. 1 in. overlap onto the adjacent curtain wall assembly (Item 2) and the concrete floor assembly (Item 1). Overlap joints in the tape system by 1/2 in.

SEALANT – Apply non-sag or self-leveling sealant to cover the exposed surface of the packing material (Item 3A) compressed and installed in the perimeter joint. Apply min. 1/4 in. thickness non-sag or self-leveling sealant over the packing material (Item 3A) and finish flush with the top surface of the concrete floor assembly (Item 1).

SUPPORT CLIPS – (Optional) Recommended for installations subject to vertical shear



movement. Use standard 20 GA galvanized steel Z-shaped clips having the following nominal dimensions: 1 in. wide × 3 in. high with a 2 in. upper leg and a 3 in. lower leg.

Consult the listing report on the Directory of Building Products (<https://bpdirectory.intertek.com>) for the edition of the standard(s) evaluated.

Compliance of the assembly described in this Design Listing with the referenced standard relies on verification that the assembly constructed in the field is consistent with that described herein. Intertek certified products may be verified by the approved Intertek label; other products must be verified by the Authority Having Jurisdiction as meeting the specifications stated herein.