


Rectorseal, LLC
Design No. TRC/BP 120-07
Perimeter Fire Barriers
ASTM E2307

**Biostop 750, Biostop 800, Flamesafe FS 3000, Flamesafe FS 4000,
Metacaulk 835+ Caulk, Metacaulk 835+ SL, Metacaulk 835+ Spray,
Metacaulk 1200 Spray, and Metacaulk 1500 Spray**

F-Rating	2 Hour
T-Rating	1-3/4 Hour
L-Rating (UL 2079)	<1.0 SCFM/LF
Cycling (%)	Class IV:
Horizontal	± 15
Vertical	± 6.25



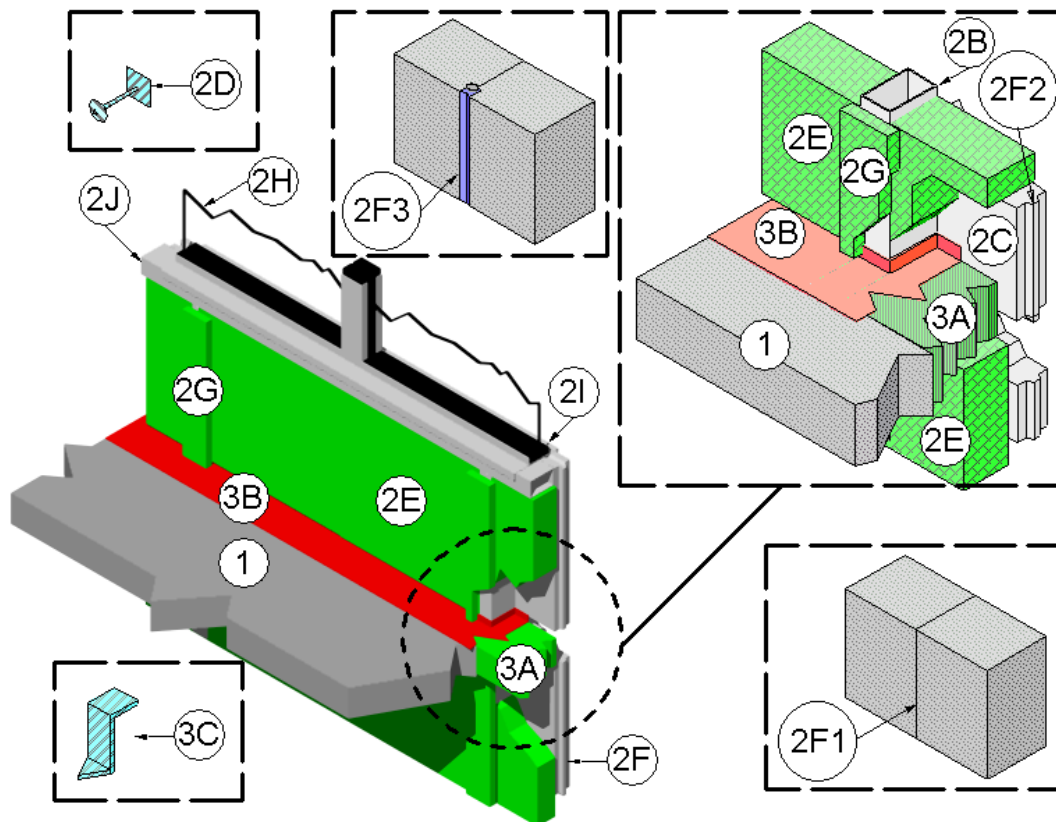

1. **CONCRETE FLOOR ASSEMBLY:** Two-hour rated concrete floor assembly made from either lightweight or normal weight concrete with a density of 100 to 150 pcf, having a min. thickness of 4-1/2 in. at the joint face. When a longitudinal recess (blockout) is required to contain an architectural joint system, increase concrete floor assembly thickness to maintain a min. thickness of 4-1/2 in. and accommodate depth of blockout formed in the concrete: blockout width unrestricted.
2. **CURTAIN WALL ASSEMBLY:** Incorporate the following construction features:
 - A. **MOUNTING ATTACHMENT:** (Not shown) Attach aluminum framing to the structural framing according to the curtain wall manufacturer's instructions. When required, connect the mounting attachments to the joint face of the concrete floor assembly according to the curtain wall manufacturer's instructions. Limit distance between mounting attachments to max. 48 in.
 - B. **ALUMINUM FRAMING:** Use a min. 2-1/2 in. wide by 4 in. deep, 0.100 in. thick rectangular aluminum tubing members. Attach according to the curtain wall system manufacturer's guidelines. Locate vertical framing a max. spacing of 60 in. on center (oc) and position on the internal side of the concrete panels only. When required, install horizontal framing members according to the curtain wall system manufacturer's guidelines.
 - C. **CONCRETE PANELS:** Use any non-combustible exterior concrete-based panels. Use min. 1-1/2 in. thick, 12 in. high, 12 in. long panels. Attach concrete panels to aluminum framing according to the curtain wall system manufacturer's requirements.
 - D. **IMPALING PINS:** When used with curtain wall insulation and framing covers, locate, size, and install impaling pins according to

the curtain wall system manufacturer's guidelines, or be a min. 4-1/2 in. long, 12 GA pin, attached to one of the following: a nominal 2 in. by 2 in. plate; a nominal 2 in. by 2 in. by 2 in. long angle; or can be directly attached to the aluminum framing using a stud gun. Space impaling pins a max. of 12 in. oc. Install impaling pins around the periphery of the curtain wall insulation so that its interior face is flush with the interior face of the aluminum framing.

- E. **CURTAIN WALL INSULATION:** Use a nominal 4 in. thick, 4 pcf, mineral wool batt insulation faced on one side with aluminum foil scrim (vapor retarder), which is exposed to the room interior and installed the full depth of the stud cavity. Install curtain wall insulation between aluminum framing. Secure curtain wall insulation with clips, impaling pins, or friction fit using curtain wall insulation length at least 1/4 in. longer than the distance between aluminum framing. Seal all meeting edges of curtain wall insulation with nominal 4 in. wide pressure sensitive aluminum foil faced tape centered over the junction so that approximately 2 in. of tape covers each edge of the adjacent curtain wall insulation. Apply pressure sensitive aluminum foil faced tape over all meeting edges of curtain wall insulation and aluminum framing so that approximately 2 in. covers each edge of the adjacent material.

Option – In lieu of filling the full depth of the stud cavity with 4 in. thick, 4 pcf curtain wall insulation, use min. 2 in. thick, 8 pcf curtain wall insulation mechanically secured and must use additional 1-1/2 in. x 1-1/2 in. x 20 GA horizontal support angle installed at the mid depth of the perimeter joint protection and mechanically attached to all aluminum framing. When required, compress interior face of curtain wall



insulation flush with the interior face of the aluminum framing. Install 24 in. wide curtain wall insulation without vertical seams, spanning the full length between aluminum framing. Locate horizontal seams in the curtain wall insulation at least 6 in. from the top surface of the perimeter joint protection.

- F. **CONCRETE PANEL JOINT:** No through joints allowed. When required, the surface of the concrete panel joints can be sealed with gaskets or sealants. Use one of the following for vertical and horizontal concrete panel joints:
 - 1. flush type (butt joint), or
 - 2. keyway type (tongue and groove), or
 - 3. recessed.
- G. **FRAMING COVERS:** Make from strips of 1 in. thick by 4 in. wide, 8 pcf density, mineral wool batt insulation faced on one side with aluminum foil scrim (vapor retarder), which is exposed to the room interior. Center framing covers over all aluminum framing and secure using impaling pins. Do not pass framing covers through the perimeter joint protection. Allow framing covers to abut top and bottom surfaces of the perimeter joint protection provided that no deformation occurs.
- H. **GLASS VISION PANELS:** (Optional) When used, locate glass vision panels above spandrel area and a min. 6 in. above the top surface of the concrete floor assembly. Install glass vision panels to window framing according to manufacturer's guidelines. Use a min. 1/4 in. thick, clear tempered glass with a max. 56-1/2 in. width and max. 69 in. height.
- I. **WINDOW GASKETS:** When glass vision panels are used, use a thermal break (thermal-set rubber extrusion) to secure glass vision panels.

- J. **WINDOW FRAMING:** When glass vision panels are used, use steel framing members a min. 3-5/8 in. by 1-5/8 in., 18 GA steel U-shaped channel, or similar construction compatible with aluminum framing. Locate window framing at least 6 in. above the top surface of the concrete floor assembly.

3. PERIMETER JOINT PROTECTION: Do not exceed an 8 in. nominal joint width (joint width at installation). Incorporate the following construction features for the perimeter joint protection (also known as perimeter fire barrier system):

- A. **PACKING MATERIAL:** Use a min. 4 in. thick, 4 pcf density, mineral wool batt insulation installed with the fibers running parallel to the edge of concrete floor assembly and curtain wall assembly. Cut packing material width to achieve 50% compression when installed in the nominal joint width. Compress the packing material into the perimeter joint. Tightly compress together splices (butt joints) in the lengths of packing material by using min. 1/4 in. compression per piece of packing material. Use only Intertek certified products meeting the above min. requirements. When a spray coating is used, locate the top surface of the packing material flush with the top surface of the concrete floor assembly. When the non-sag or self-leveling silicone sealant is used, recess the top surface of the packing material 1/4 in. from the top surface of the concrete floor assembly.
- B. **JOINT SEALANT:** Rectorseal, LLC Biostop 750, Biostop 800, FlameSafe FS 3000, FlameSafe FS 4000, Metacaulk 835+ Caulk, Metacaulk 835+ SL, Metacaulk 835+ Spray, Metacaulk 1200 Spray, or Metacaulk 1500 Spray



FILL, VOID OR CAVITY MATERIAL: Apply either spray coating or non-sag or self-leveling silicone sealant over the packing material as follows:

Spray Coating – spray apply the liquid to cover the exposed top surface of the packing material) compressed and installed in the perimeter joint. Apply a min. wet film thickness of 1/8 in. and overlap the spray coating a min. 1/2 in. onto the adjacent curtain wall assembly and concrete floor assembly. When the spraying process is stopped and the applied spray coating cures to an elastomeric film before installation process is restarted, then overlap the edge of the cured spray coating at least 1/8 in. with the liquid spray coating.

Sealant – apply non-sag or self-leveling sealant to cover the exposed surface of the packing material compressed and installed in the perimeter joint. Apply min. 1/4 in. thickness non-sag or self-leveling sealant over the packing material and finish flush with the top surface of the concrete floor assembly.

- C. SUPPORT CLIPS: (Optional) Recommended for installations subject to vertical shear movement. Use standard 20 GA galvanized steel Z-shaped clips having the following nominal dimensions: 1 in. wide by 3 in. high with a 2 in. upper leg and a 3 in. lower leg.

* Before testing, the test specimen was subjected to $\pm 6.25\%$ vertical and $\pm 15\%$ horizontal movement a min. of 500 times at 30 cpm, for both vertical and horizontal cycling per ASTM E1399.

Consult the listing report on the Directory of Building Products (<https://bpdirectory.intertek.com>) for the edition of the standard(s) evaluated.

Compliance of the assembly described in this Design Listing with the referenced standard relies on verification that the assembly constructed in the field is consistent with that described herein. Intertek certified products may be verified by the approved Intertek label; other products must be verified by the Authority Having Jurisdiction as meeting the specifications stated herein.