


DESIGN NO. TRC/PV 60-01
VERTICAL (WALL), F & T RATINGS - 1 HR; ANNULAR SPACING - 1-3/8" MAX.
TEST PRESSURE DIFFERENTIAL - 2.5 Pa (0.01" OF WATER) MINIMUM

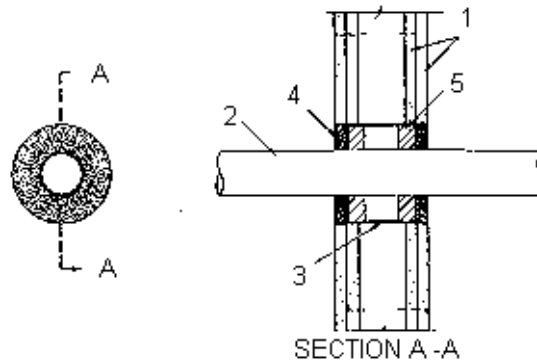

Manufacturer's Designation: 950 GW-2.

1. Wall: Nominal 5" thick steel or wood stud fire rated gypsum drywall partitions, concrete block or concrete, with a 5-1/4" diameter opening.
2. Penetrations: 1) 2" I.D. PVC Pipe - Schedule 40.
3. Forming Materials: Materials are used as a form and seal to prevent leakage of the sealant during construction.
 - a) 0.012" diameter galvanized steel wire mesh 1/8" on center, both directions.
4. Caulking Compound or Filler Material: Minimum thickness 3/4" Metalines, Inc. Metacaulk* 950 each side of partition.
5. Insulation: Foam Backing Material.

*Component bearing the Warnock Hersey Certification Mark