


DESIGN NO. TRC/PV 120-06
VERTICAL (WALL), F RATING - 2 HRS, T RATING - 1-1/2 HRS;
ANNULAR SPACING - 3/8" MAX.
TEST PRESSURE DIFFERENTIAL - 2.5 Pa (0.03" OF WATER) MINIMUM

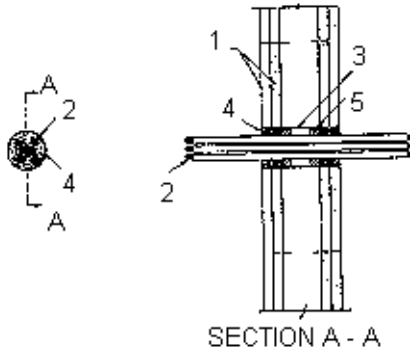

Manufacturer's Designation: 950 GW-3.

1. Wall: Nominal 5" thick steel or wood stud fire rated gypsum drywall partitions; concrete block or concrete with a 2-1/2" diameter opening.
2. Penetrations: 1) 5 Telephone Cables, each consisting of 25 paired insulated telephone wires.
3. Forming Materials: Materials are used as a form and seal to prevent leakage of the sealant during construction:
 - a) 0.012" diameter galvanized steel wire mesh; 1/8" on center both directions.
4. Caulking Compound or Filler Material: Minimum thickness 1-1/4" Metalines, Inc. Metacaulk* 950 each side of partition.
5. Insulation: Foam Backing Material.

*Component bearing the Warnock Hersey Certification Mark