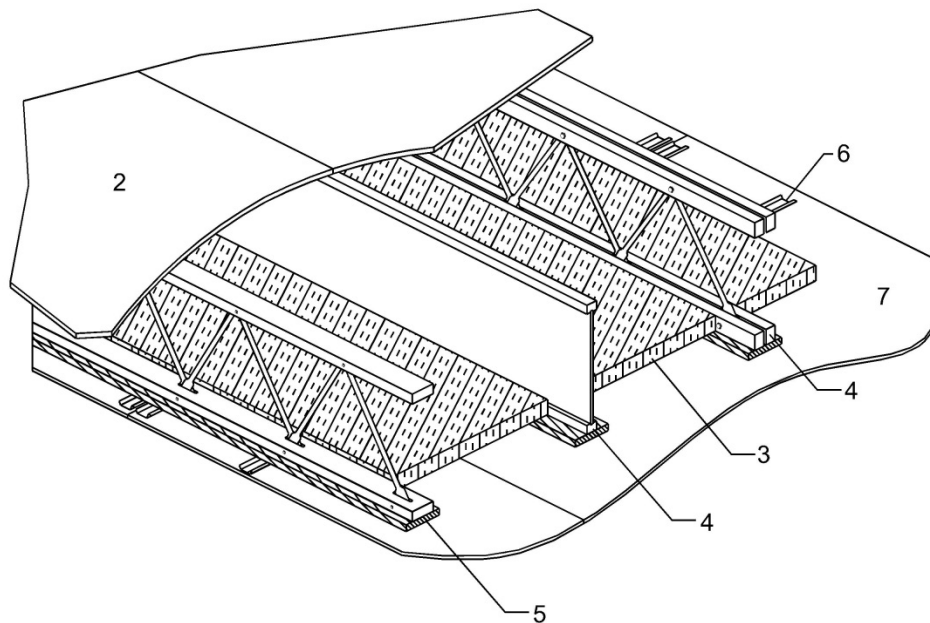

Design Number RBL/SFWT 60-03
REDBUILT OPEN-WEB TRUSS & RED-I JOIST SERIES

RedBuilt LLC
ASTM E119 and CAN/ULC S101
Load Bearing Fire Resistance Rated Roof/Ceiling, Floor/Ceiling Assembly
60-Minute Rating



1. FLOOR TOPPING (Optional, not shown): Gypsum concrete, lightweight or normal concrete topping. When used as a roof assembly, materials for a built-up roof covering that are described in an assembly that provides a Class A, B, or C rating on combustible wood decks may be used.

2. FLOOR SHEATHING: Min. 5/8 in. thick wood sheathing, designed and installed per code requirements. When used as a roof assembly, min. 1/2 in. thick wood sheathing may be used, when designed and installed per code requirements.

3. INSULATION: Min. 2 in. thick mineral wool insulation batts – 3.5 pcf (min.), supported by setting strip edges, friction-fitted between the sides of the joist flanges. Ends of batts shall be centered over resilient channels and tightly butted.

4. CERTIFIED COMPANY: RedBuilt LLC

CERTIFIED PRODUCT: Shop fabricated wood trusses

CERTIFIED MODELS:

RED-I JOIST SERIES: RED-I45L, RED-I53, RED-I58, RED-I45, RED-I65, RED-I90, RED-I90H and RED-I90HS.

OPEN-WEB TRUSS SERIES: RED-L, RED-W, RED-S, RED-M and RED-H.

9 1/4 in. min. deep joists spaced a max. of 24 in. on center (oc). Installed in accordance with the Code.

5. SETTING STRIPS: Min. 1x4 (nominal) wood setting strips attached with 1-1/2 in. long Type W screws at 24 in. oc along the

bottom flange of joist creating a ledge to support insulation.

6. RESILIENT CHANNELS: Min. 0.019 in. thick galvanized steel resilient channels, attached perpendicular to joists using 1-5/8 in. long drywall screws. Resilient channels spaced 16 in. oc. Additional channels are required at gypsum board end joints so that each board is attached to a separate channel. These additional channels shall extend to the next joist on each side of the board end joint.

7. GYPSUM WALLBOARD: Min. 5/8 in. thick Type C gypsum wallboard installed with long dimension perpendicular to resilient channels and fastened to each channel with min. 1-1/8 in. long Type S drywall screws. Fasteners spaced 7 inches oc and 1-1/2 in. from panel edges and ends. Edge joints shall be centered between joists. End joints shall be staggered one channel spacing.

8. FINISH SYSTEM (Not Shown): Face layer joints covered with tape and coated with joint compound. Screw heads covered with joint compound.