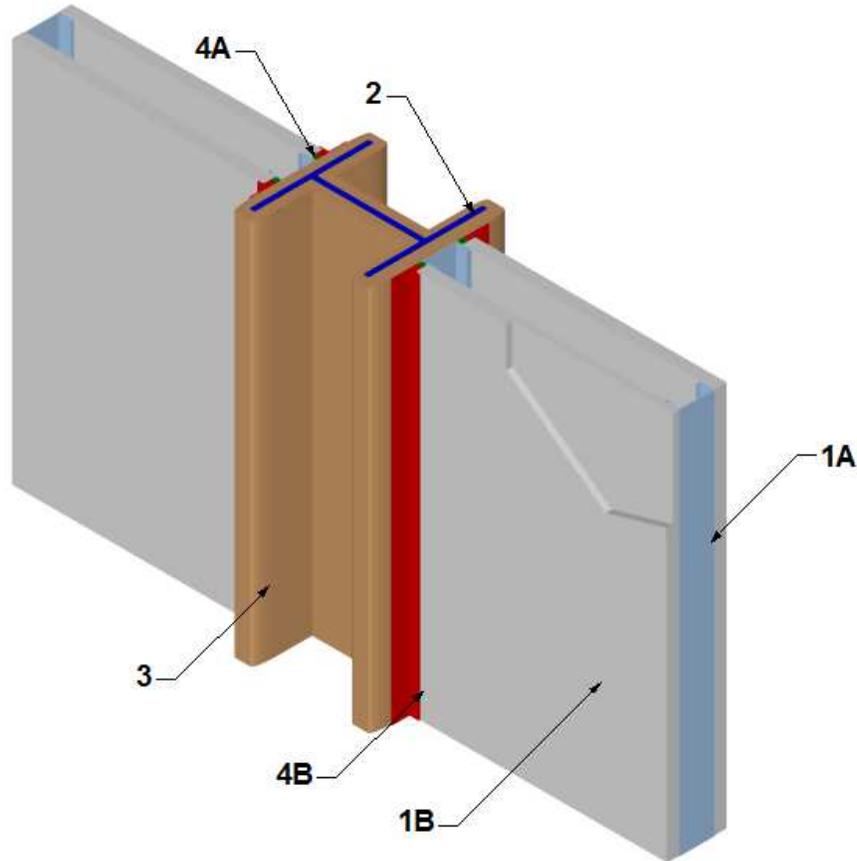

Design Number STI/JF 120-02
Vertical Joint System
Specified Technologies, Inc.
SpecSeal LCI Intumescent Firestop Sealant
ASTM E 1966
Rating: 120 Minutes
Cycling: None



1. WALL ASSEMBLY: Construct 2-hour rated wall assembly containing the following elements:
 - A. STEEL STUDS: Install minimum 3-5/8 in. deep, 25 GA galvanized steel studs spaced maximum 24 in. on center (oc) and floated between 3-5/8 in. deep 25 GA top and bottom track (not shown).
 - B. Gypsum Board: Install two layers of 5/8 in. Type X gypsum board to both sides of wall assembly secured to the steel studs (Item 1A), offset

maximum 1 in. from fireproof coating. Secure base layer to steel studs (Item 1A) using minimum 1 in. long Type S self-drilling screws spaced maximum 16 in. oc around the perimeter and maximum 16 in. oc in the field. Install face layer with joints offset 24 in. from the base layer and secured using minimum 1-5/8 in. long Type S self-drilling screws spaced 16 in. oc around the perimeter and 16 oc in the field staggered 8 in. from the base layer fasteners.

Division 07 – Thermal and Moisture Protection
07 80 00 Firestopping
07 84 43 Joint Firestopping

Page 2 of 2

- C. Joint Tape and Compound – (Not Shown) Apply a level 2 finish of vinyl or casein, dry or premixed joint compound as follows. Apply to gypsum board face layer (Item 1B) in two coats to all exposed fastener heads and gypsum board joints. Embed minimum 2 in. wide paper, plastic, or fiberglass tape in first layer of compound over joints in face layer of the gypsum board (Item 1B).
2. COLUMN: Install minimum W 14 x 61 structural steel column in accordance with the applicable building code requirements. Center wall assembly (Item 1) against the flanges of the column after installation of the fireproof coating (Item 3).
3. FIREPROOF COATING: Apply Isolatak Cafco 300 Fireproofing to the column per the manufacturer's installation instructions to maintain a minimum 2-hour fire resistance rating.
4. FIRE RESISTIVE JOINT SYSTEM: Install non-loadbearing fire resistive joint

system between gypsum wall assembly (Item 1) and column (Item 2) containing the following elements. Maintain maximum joint width of 1in.

- A. PACKING MATERIAL: Install nominal 4 pcf density mineral fiber insulation bearing the Intertek Certification Mark compressed minimum 50% in the joint opening.
- B. CERTIFIED COMPANY: Specified Technologies, Inc.

CERTIFIED PRODUCT: Fire Resistant Joint Sealants

MODEL: SpecSeal LCI Intumescent Firestop Sealant

FILL, VOID OR CAVITY MATERIAL: Apply minimum 1/8 in. (wet film thickness) thick layer of fill material over fire resistive joint system ensuring minimum 2 in. overlap onto fireproof coating (Item 3) and minimum 1/2 in. onto face of gypsum wall assembly (Item 1).