


GP Gypsum
Design No. GP/GBA 120-03
Horizontal Shaftwall Gypsum Board
DensGlass® Shaftliner and ToughRock® Shaftliner
ASTM E119, CAN/ULC S101

Rating: 2 Hour Unrestrained, Non-Loadbearing

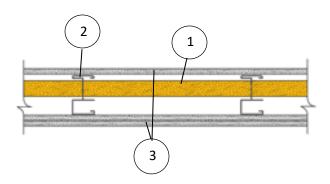

 CERTIFIED MANUFACTURER: Georgia Pacific Gypsum, LLC.

CERTIFIED PRODUCT: DensGlass® Shaftliner and ToughRock® Shaftliner

GYPSUM SHAFTLINER: 1 in. thick DensGlass® Shaftliner or ToughRock® Shaftliner Type X, supplied in nominal 24 in. widths. The panels are inserted against the long leg of the 'J' runners and into the 1 in. deep recess of the C-T studs. Edges or ends of panels are retained by binding 'J' runner tabs (12 in. on center (oc)) at a 90° angle or by using the Optional Item.

2. STEEL STUD: 'C-T' shaped slotted web studs, 1-1/2 in. wide × 2-1/2 in. min. deep, fabricated from min. 0.019 in. (26 GA) thick hot dipped galvanized steel. Friction filled 24 in. oc max. with 'J' runner flanges. Cut studs 1/2 in. less than the span between 'J' runner webs at the ends and fit between panels of Shaftliner.

3. GYPSUM BOARD: 1/2 in. thick ToughRock® Fireguard C gypsum board or 1/2 in. thick DensArmor Plus® Fireguard C gypsum panels, applied in two layers on exposed side and one layer on unexposed side, parallel or perpendicular to studs and with edge joints offset 18 in. between layers. Exposed side base layer attached with 1 in. drywall screws 12 in. oc in the field and 8 in. oc at butt joints. Face layer attached to framing with 1-5/8 in. Type S drywall screws 12 in. oc and 8 in. oc at butt joints, additionally 1-1/2 in. Type G drywall screws at 8 in. oc parallel to and offset 4 in. from butt joints. Unexposed side gypsum board attached with 1-1/2 in. Type G drywall screws 12 in. oc installed 4 in. on either side of C-T studs. Butt joints are centered on stud flanges and are offset to different studs between adjoining panels and between layers. Face layer joints are taped and finished, face layer screws are finished with ready mixed joint compound.



Division 09 – Finishes 09 20 00 Plaster and Gypsum Board 09 21 16 Gypsum Board Assemblies

4. PERIMETER FRAMING (Not Shown): 'J' shaped runner with unequal legs, 2-1/2 in. min. deep, fabricated from min. 0.019 in. (26 GA) hot dipped galvanized steel. Secured around the perimeter with suitable fasteners, 24 in. oc max.

Consult the listing report on the Directory of Building Products (https://bpdirectory.intertek.com) for the edition of the standard(s) evaluated.

Compliance of the assembly described in this Design Listing with the referenced standard relies on verification that the assembly constructed in the field is consistent with that described herein. Intertek certified products may be verified by the approved Intertek label; other products must be verified by the Authority Having Jurisdiction as meeting the specifications stated herein.

Version: 02 August 2017 SFT-BC-OP-19i