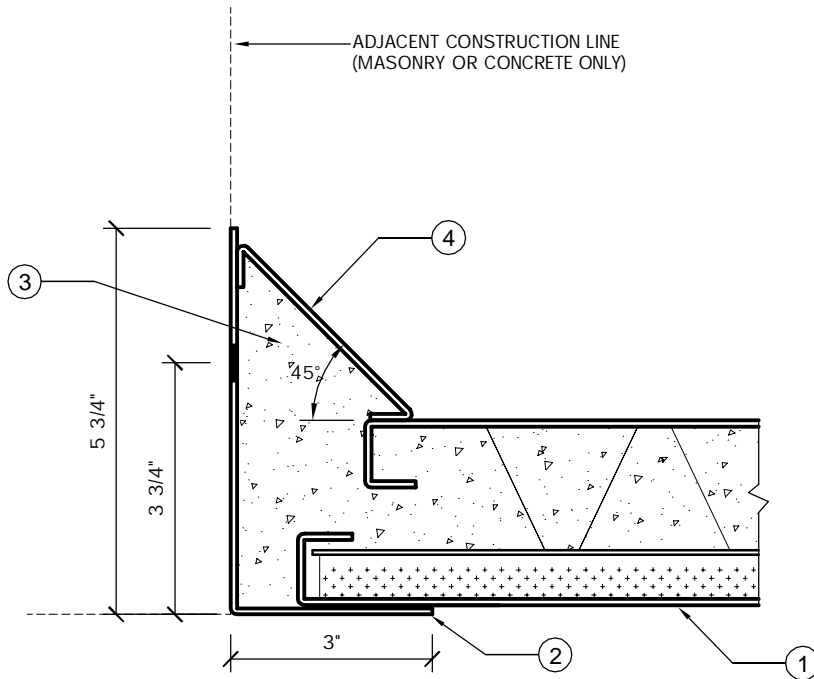

Trussbilt Manufacturing End of Wall Joint Detail

Detail No. E04

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBM/MWP 60-01 or TBM/MWP 120-01



1. Trussbilt fire rated wall panel TBM/MWP 60-01 (1 hour rating) or TBM/MWP 120-01 (2 hour rating)
 2. 12 gauge (minimum) A60 or 409SS wall channel:
 - Concrete / Masonry Substrate: prepared with holes for 3/8" (minimum) diameter mechanical anchors at 18" o.c. (maximum)
 3. Cavity between end of wall panel and trim piece to be filled with concrete or rockwool insulation (4 PCF compressed 50% minimum).
 4. 12 gauge (minimum) A60 or 409SS wall closure plate welded to wall panel and wall channel.
-