


## Trussbilt Manufacturing Bunk Attachment Detail Detail No. M04

Investigated by Intertek for compliance with applicable requirements. For use with  
Trussbilt's Fire Rated Wall Panel System TBM/MWP 60-01 or TBM/MWP 120-01  
For use with load bearing and non-load bearing wall installations.

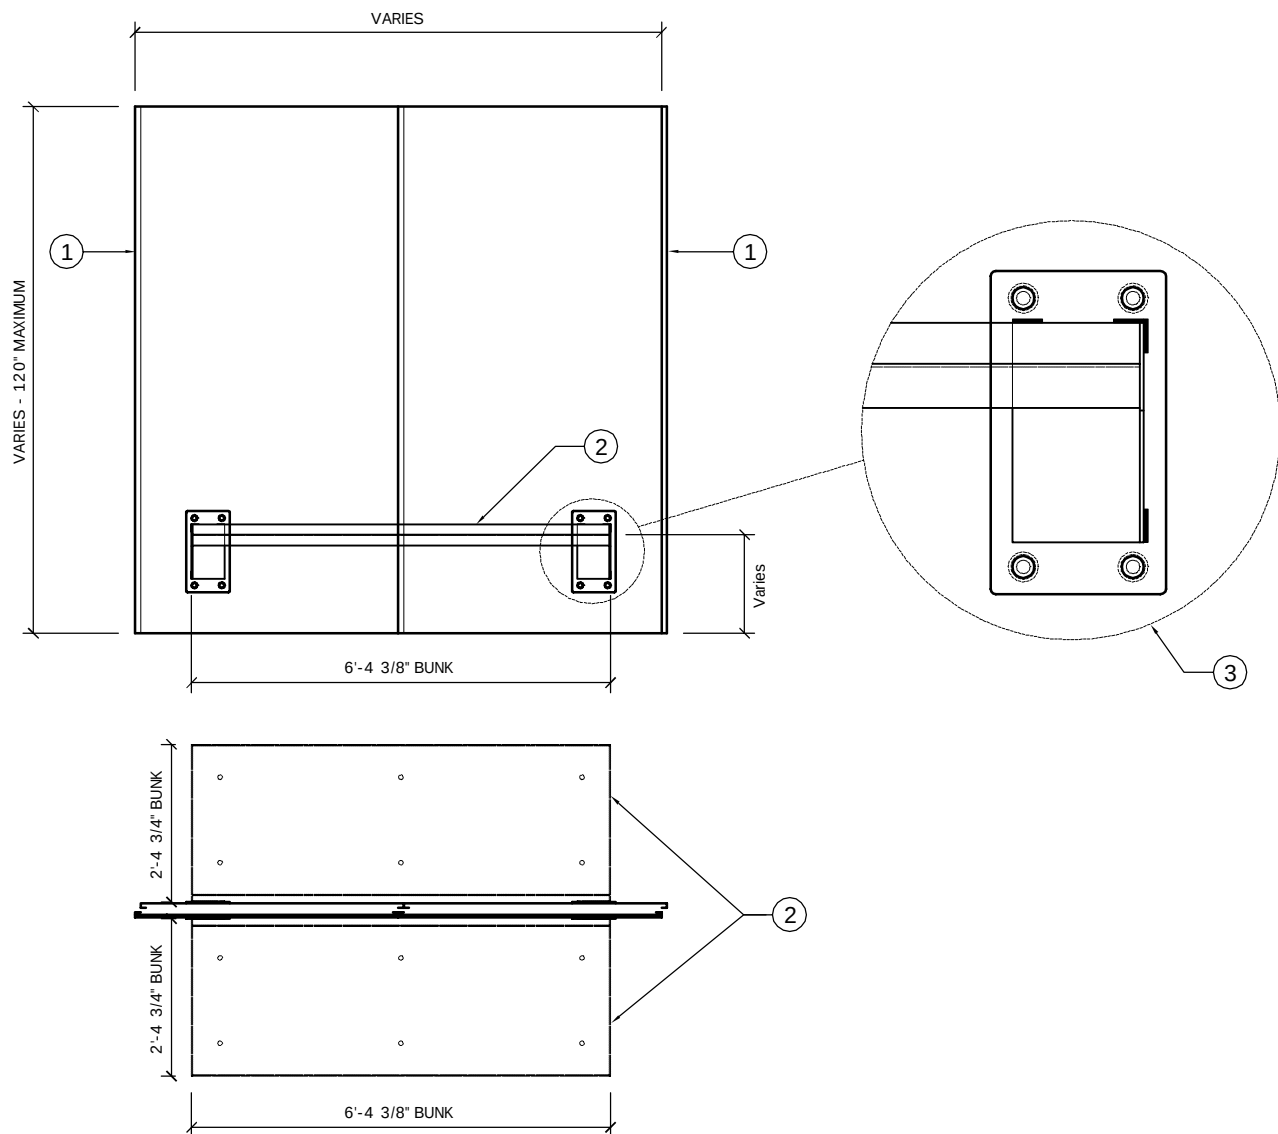

1. Trussbilt fire rated wall panel TBM/MWP 60-01 (1 hour rating) or TBM/MWP 120-01 (2 hour rating)
2. 10 gauge bunk.
3. Bunk mounting bracket. Refer to page 2 of 2.