


## Trussbilt Manufacturing FR Trusswall Stacking Detail Detail No. M03

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBM/MWP 60-01 or TBM/MWP 120-01.  
For use with non-bearing wall installations.

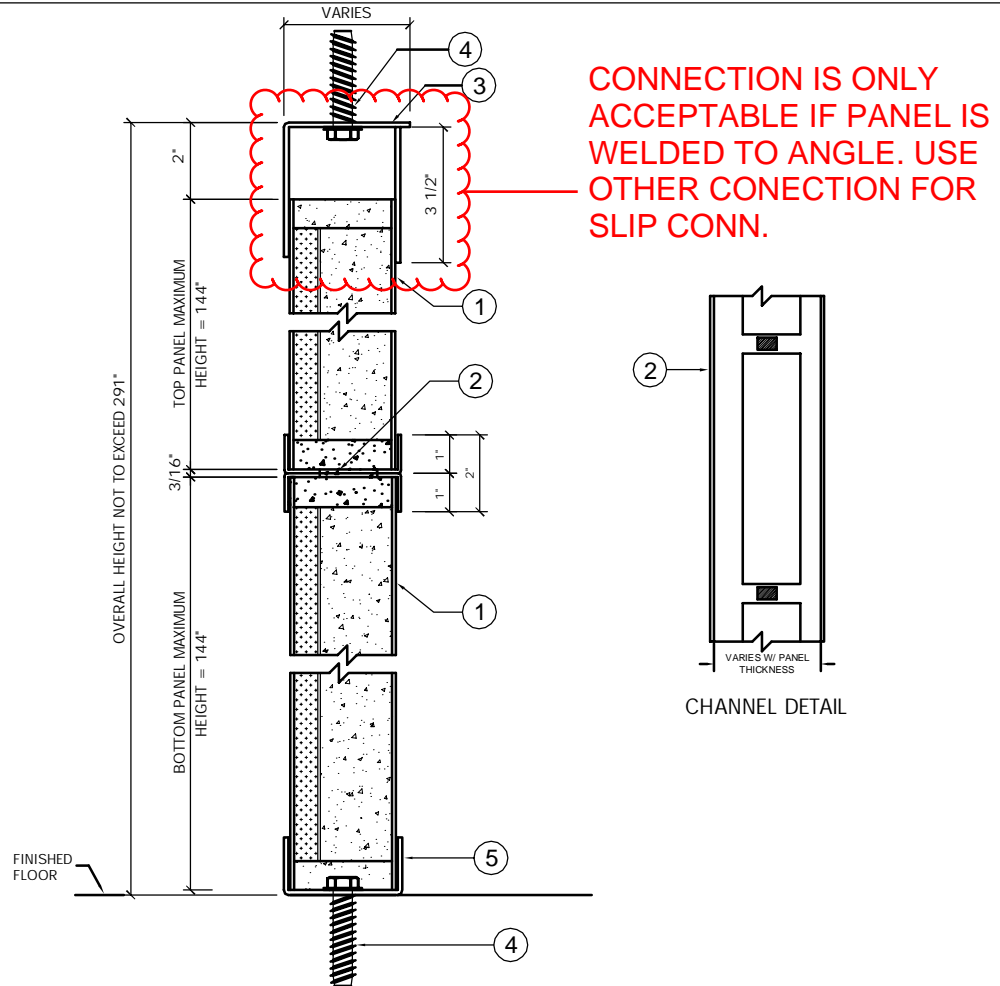

1. Trussbilt fire rated wall panel TBM/MWP 60-01 (1 hour rating) or TBM/MWP 120-01 (2 hour rating)
2. 12 gauge minimum galv. channel w/ grout slots. (2) channels spot or plug welded together, maximum 6-1/2" O.C., to form "H" channel. Welded to panels per manufacturer's instructions.
3. Panel to ceiling attachment may vary.
4. 1/2" x 2-1/2" min. concrete anchor, 18" maximum O.C.
5. Floor channel welded to panel per manufacturer's instructions. Refer to detail B01.