
## Trussbilt Manufacturing Frame Installation Detail Detail No. F04

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBM/MWP 60-01 or TBM/MWP 120-01 For use with load bearing and non-load bearing wall installations.



- 1. Trussbilt fire rated wall panel TBM/MWP 60-01 (1 hour rating) or TBM/MWP 120-01 (2 hour rating)
- 2. 12 gauge minimum galv. "Z" channel w/ slotted grout holes. Spotwelded in place.
- 12 gauge fire rated window frame welded to fire rated wall panel per manufacturers instructions. Frame to be grouted. Minimum jamb depth 4-1/2".
- 4. Minimum 12 gauge glazing stop secured with 1/4" screws 2" max. from ends and 8" max. o.c.

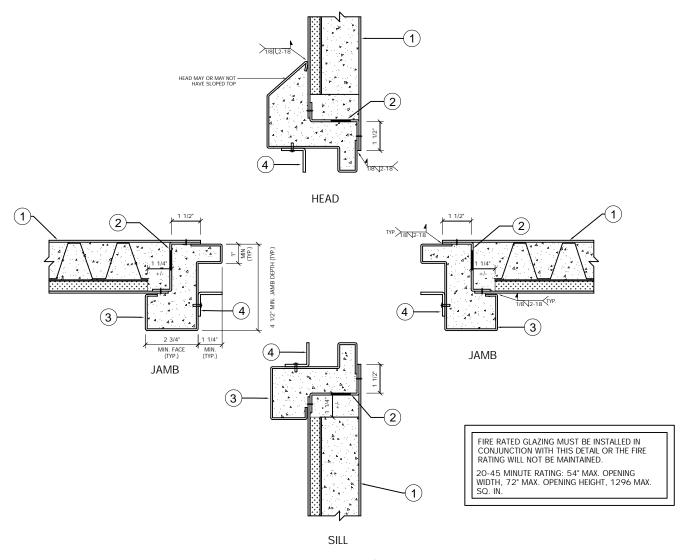

Valued Quality. Delivered.