



Trussbilt Manufacturing Frame Installation Detail

Detail No. F01

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBM/MWP 60-01 or TBM/MWP 120-01
For use with load bearing and non-load bearing wall installations.

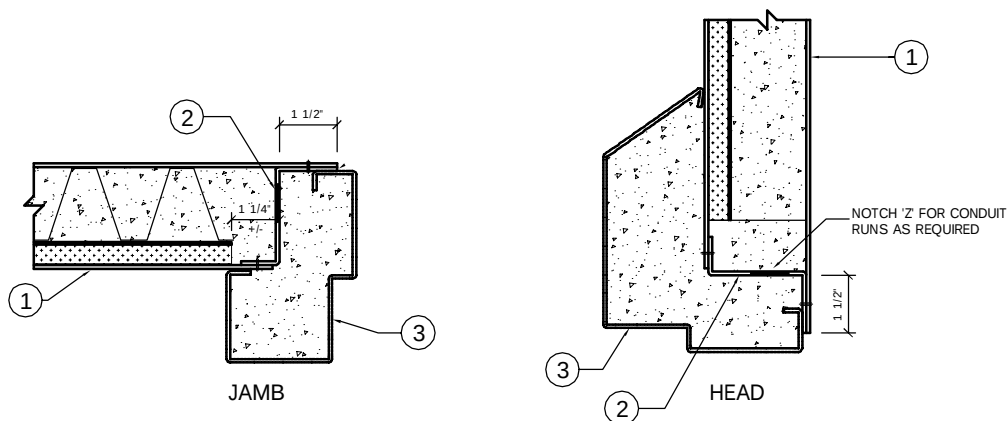

A FIRE RATED DOOR AND FRAME ASSEMBLY
(INCLUSIVE OF RATED HARDWARE AND GLAZING)
MUST BE INSTALLED IN CONJUNCTION WITH THIS
DETAIL OR THE FIRE RATING WILL NOT BE
MAINTAINED.

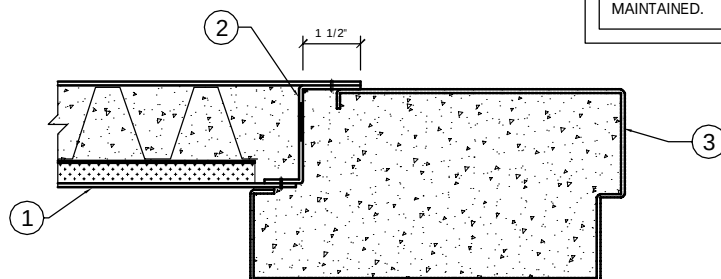

JAMB @ WIDE JAMB LOCK

1. Trussbilt fire rated wall panel TBM/MWP 60-01 (1 hour rating) or TBM/MWP 120-01 (2 hour rating)
2. 12 gauge minimum galv. "z" channel w/ slotted grout holes. Spotwelded in place.
3. Fire rated frame and door assembly welded to fire rated wall panel per manufacturers instructions. Frame to be grouted.