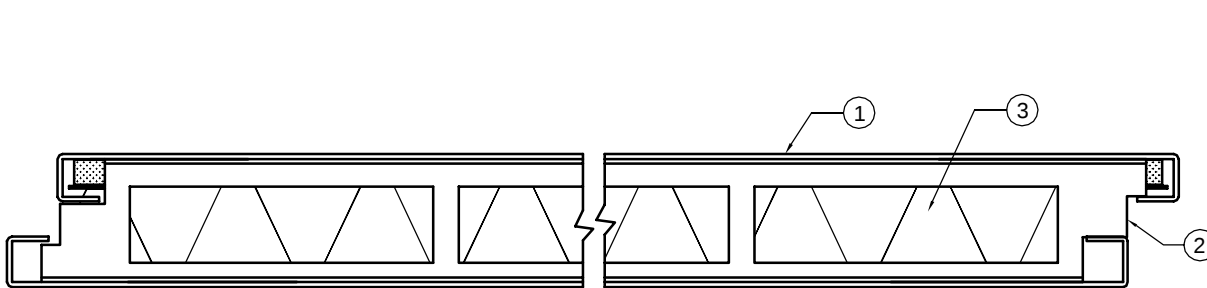
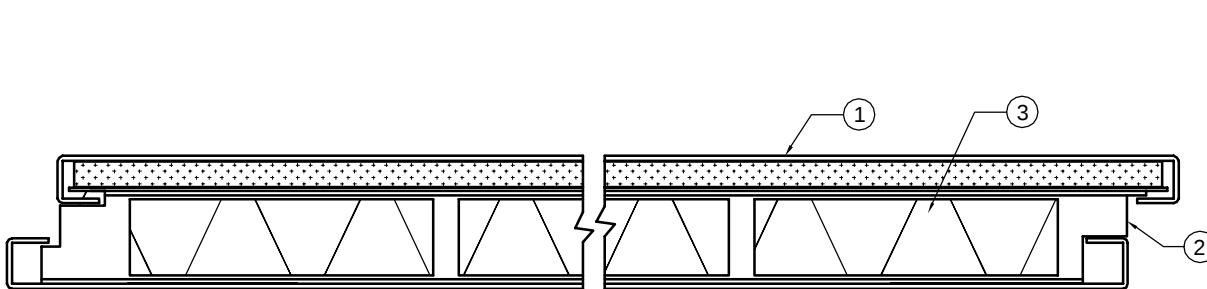

Trussbilt Manufacturing
Optional Top of Panel Stiffeners
Detail No. M06

Investigated by Intertek for compliance with applicable requirements. For use with Trussbilt's Fire Rated Wall Panel System TBM/MWP 60-01 or TBM/MWP 120-01



TOP VIEW INSTALLED IN PANEL



TOP VIEW INSTALLED IN PANEL

1. Trussbilt fire rated wall panel TBM/MWP 60-01 (1 hour rating) or TBM/MWP 120-01 (2 hour rating)
 2. 16, 14 or 12 gauge A60 channel tack welded to both face sheets.
 3. Grout slot.
-