


DESIGN NO. PS/PH 120-10
HORIZONTAL (FLOOR), RATINGS: ASTM-E814 - 2 HRS (F), 2 HRS (T)
TEST PRESSURE DIFFERENTIAL - 2.5 Pa (0.01" OF WATER) MINIMUM

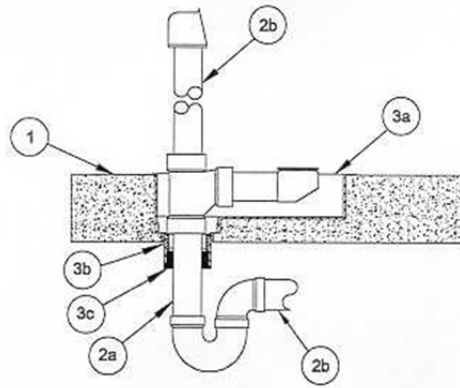

1	Floor: Minimum 3" thick normal density concrete slab.
2	Pipe Materials & Pipe Support: a) ProSet 1-1/2" P-92 FR PVC Pipe b) Sch. 40 ABS or Cellular core PVC pipe. P-Trap and branch piping to be reliably supported.
3	Firestop System Components: a) ProSet P25620S FR PVC Tub Box*. b) ProSet 2" Coupling* extension solvent welded into tub box after the pour with one 1/8" x 3/4" factory built-in intumescent wrap strip on the top side of coupling. c) ProSet ProSeal P-20112 or P-25661 inserted bottom of coupling around the P-90 pass through pipe seal the opening.

*Component bearing the Warnock Hersey Certification Mark.