

Specified Technologies, Inc.

Design No. STI/BPF 180-01

Perimeter Fire Barrier System – Curtain Wall Assembly

SpecSeal® AS200 Series Elastomeric Spray or

SpecSeal® FastTack® Firestop Spray

ASTM E2307, CAN/ULC-S115


Ratings: F-Rating – 3 Hour or 2-1/2 Hour (Item 4); T-Rating – 1-3/4 Hour or 1-1/2 Hour (Item 4)

UL 2079 L-Rating < 2 SCFM/LF


ASTM E1399

Movement Type = Class IV


Rated for ± 5% Vertical Movement @ 25% Compression (Item 4A)

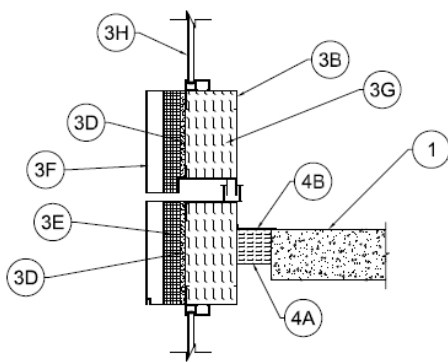

Between Anchors

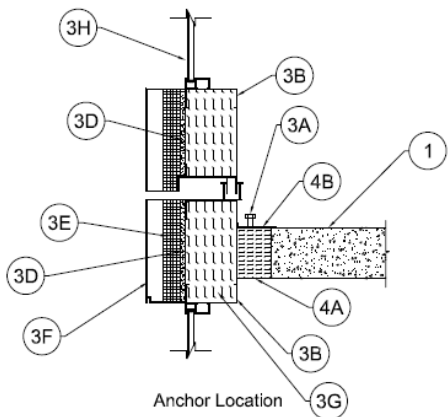

Anchor Location

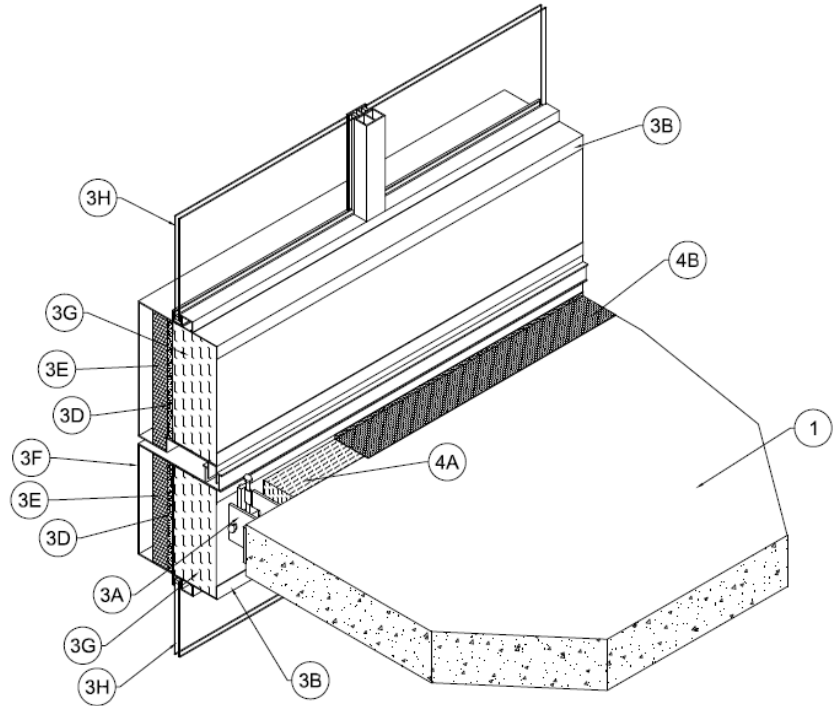

SIDE ELEVATION VIEWS



1. **CONCRETE FLOOR ASSEMBLY:** Min. two hour rated concrete floor assembly made from either lightweight or normal weight concrete with a density of 100-150 pcf, with a min. thickness of 6 in. (152 mm) at the joint face. F-rating of perimeter joint system will be limited to the fire rating of the floor system with a max. three hour F-rating.

2. **INTERIOR WALL ASSEMBLY:** (Optional, Not shown) The interior wall assembly shall incorporate the following construction features:

A. **INTERIOR STEEL STUD FRAMING** – Min. 24 GA, 3-1/2 in. (89 mm) or larger steel studs and track. Track is to be secured directly to the underside of the concrete floor assembly (Item 1). Framing spacing dimensions are to be max. 24 in. (610 mm) on center (oc). As an option, a framed knee wall may also be constructed above the concrete floor assembly.

B. **INTERIOR GYPSUM WALLBOARD** – Min. 1/2 in. (13 mm) interior gypsum wallboard mounted to the interior side of the interior steel stud framing (Item 2A). Secure with self-tapping drywall screws with spacing as directed by gypsum wallboard manufacturer.

3. **CURTAIN WALL ASSEMBLY:** Construct the exterior wall assembly in compliance with applicable building code and regulatory requirements. Spandrel panel shall extend a min. of 11/16 in. (17 mm) below the concrete floor assembly (Item 1) and shall terminate into exterior cladding (Item 3F) or vision glass (Item 3H), a min. of 1-13/16 in. (46 mm) above the concrete floor assembly, or into an exact duplicate of the spandrel panel profile with a max. 3/4 in. (19 mm) gap between the spandrel panel and the panel above, as depicted in the

illustration. Duplicate panel profile may also terminate into exterior cladding (Item 3F) or vision glass (Item 3H).

A. **MOUNTING ATTACHMENT** – The mounting attachments to the floor slab shall consist of 10-1/2 in. wide (267 mm) wide × 5-1/2 in. (140 mm) high × 3/8 in. (9.5 mm) thick aluminum brackets connecting to an extruded aluminum fist and sliding block, using steel bolts and set screws. Aluminum fist is anchored to the exterior wall framing (Item 3B). Bracket is secured to the front face of the floor (Item 1) using embedded steel anchors or nominal 5/8 in. (16 mm) diameter wedge anchors and steel washers and nuts. Joint assembly and mounting to be installed to allow for specified vertical movement and no horizontal movement.

B. **EXTERIOR STEEL STUD FRAMING** – Use min. 16 GA, 3-5/8 in. (89 mm) or larger steel studs and track. Anchor the steel stud framing to the concrete structure or structural framing in accordance with the curtain wall assembly (Item 3) manufacturer's instructions and the structural design specifications.

C. **KING STUDS** – (Not shown) Where king studs are used to support window framing on the vertical sides, use either two 16 GA steel studs tack welded face-to-face, or a single 16 GA steel stud as per the wall system design requirements. When two 16 GA steel studs are welded face-to-face, the core stud cavity between the studs may be, but is not required to be, filled with insulation.

D. **EXTERIOR GRADE CORE BOARD** – Use min. 1/2 in. (13 mm) exterior grade gypsum wallboard or fiber-reinforced cement board



mounted to the exterior side of the exterior steel stud framing (Item 3B). Secure with self-tapping drywall screws at max. 12 in. (305 mm) oc. If required, install on the exterior of the core board, an air/vapor barrier that complies with applicable building code and regulatory requirements.

- E. EXTERIOR INSULATION – Use min. 2 in. (51 mm) thick, nominal 8 pcf (128 kg/m³) density exterior grade mineral wool or actual 6 pcf (96 kg/m³), Intertek certified Thermafiber Rain Barrier HD mineral wool exterior continuous insulation installed in accordance with the exterior curtain wall assembly (Item 3) design specifications.
- F. EXTERIOR CLADDING – Use an exterior cladding system that complies with applicable building code and regulatory requirements. Install in accordance with the exterior curtain wall assembly (Item 3) manufacturer's instructions and the design specifications. Ensure a max. 3/4 in. gap between the top of the spandrel panel and the exterior panel directly above.
- G. CERTIFIED MANUFACTURER – Only Intertek Certified Manufacturer

CERTIFIED PRODUCT – Mineral Wool

CERTIFIED MODEL – Only Intertek Certified Manufacturer's product meeting the min. requirements below.

INTERIOR INSULATION – Use min. 3-1/2 in. (89 mm) thick, faced or unfaced, min. 4 pcf (64 kg/m³) mineral wool curtain wall insulation placed in the stud cavities.

- H. VISION PANELS – (Optional) Vision panels must comply with exterior curtain wall

assembly (Item 3) design specifications. Glazing panels may be secured in position with aluminum pressure plates in conjunction with glazing gaskets and steel screws, or with structural silicone installed in accordance with the manufacturer's instructions.

- I. EXTERIOR GRADE SEALANT – (Optional, Not shown) At the seams between panels, exterior grade silicone sealant may be installed for weatherproofing as needed per the wall assembly design specifications.

- 4. **PERIMETER JOINT PROTECTION:** The perimeter joint (linear opening) is not to exceed 4 in. (102 mm) nominal joint width (joint width at installation). The perimeter joint treatment shall incorporate the following construction features:

- A. CERTIFIED MANUFACTURER: Only Intertek Certified Manufacturer

CERTIFIED PRODUCT – Mineral Wool

CERTIFIED MODEL: Only Intertek Certified Manufacturer's product meeting the min. requirements below.

PACKING MATERIAL – Install min. 4 in. thick (102 mm) 4pcf (64 kg/m³) density mineral wool batt insulation, installed with the fibers running parallel to the slab edge and curtainwall. Cut and stack additional batt sections as needed so that the total thickness is min. 33% greater than the linear opening. Compress the packing material 25% in the nominal joint width. Install the batt insulation into the perimeter joint flush with the top surface of the concrete floor slab (Item 1). Splices (butt joints) in the lengths of mineral wool batt insulation are



to be tightly compressed together. At mounting bracket locations, maintain continuous insulation beneath brackets by increasing insulation to a min. 6 in. (152 mm) depth for a min. of 3 in. (76 mm) on each side of the bracket, and having a min. 1 in. (25 mm) depth below the bracket.

- B. **CERTIFIED MANUFACTURER:** Specified Technologies, Inc.

CERTIFIED PRODUCT: Joint Sealant Spray

CERTIFIED MODEL: SpecSeal® AS200 Elastomeric Firestop Spray (AS205 Series), or SpecSeal® FastTack® Firestop Spray

(*Note: A max. F-rating of 2.5 hour and T-rating of 1.5 hour may be achieved if using SpecSeal® FastTack® Firestop Spray.)

5. **FILL, VOID, OR CAVITY MATERIAL:** Apply a min. wet film thickness of 1/8 in. (3.2 mm) over the packing material (Item 4A) and overlap the liquid spray material a min. 1/2 in. (13 mm) onto the interior surface of the adjacent curtain wall assembly (Item 3) and the concrete floor slab assembly (Item 1). If the spraying process is stopped and the applied liquid spray material cures to an elastomeric film before process is restarted, then overlap the edge of the cured spray material at least 1/8 in. (3.2 mm) with the liquid spray material.

Consult the listing report on the Directory of Building Products (<https://bpdirectory.intertek.com>) for the edition of the standard(s) evaluated.

Compliance of the assembly described in this Design Listing with the referenced standard relies on verification that the assembly constructed in the field is consistent with that described herein. Intertek certified products may be verified by the approved Intertek label; other products must be verified by the Authority Having Jurisdiction as meeting the specifications stated herein.