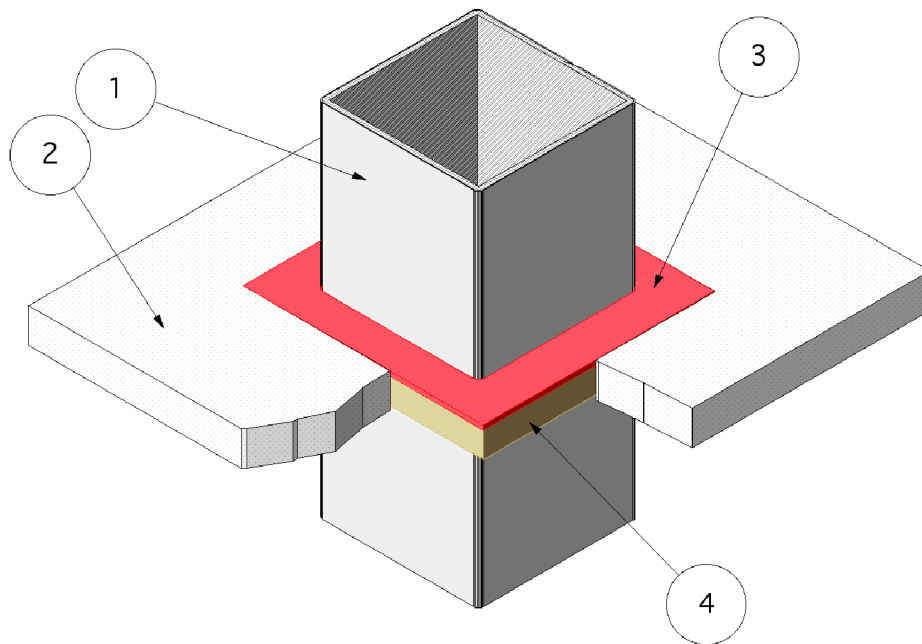

Design No. FS 560 F

FIRE PENETRATION SEAL

Penetrating Item Steel Duct

T-Rating - 2 hr

F-Rating - 2 hr



1. PENETRATING ITEM: A round or rectangular steel duct system constructed of min. 24 GA sheet steel with max. 720 in² area and max. 30-in. dimension (max. dim. 24-in. x max. 30-in., or max. 30 in. diameter) and protected with a one layer of 3M Fire Barrier Duct Wrap 15A or 20A, such as detailed in GD 532 F or GD 548 F or two layers of 3M Fire Barrier Duct Wrap 15A or 20A as detailed in GD 531 F or GD 547 F.
2. FLOOR ASSEMBLY: The two-hour fire-rated floor assembly consists of min. 4-1/2 in. thick normal weight (100-150 pcf) reinforced concrete. Create an opening in the floor assembly having a max. cross-sectional area of 1093 in² and a max. dimension of 36-3/4 in. Position the duct assembly concentrically or eccentrically in the opening so that the

annular space ranges from min. 1-1/4 in. on one side to max. 2-1/2 in. on the other.

3. FILL, VOID OR CAVITY MATERIAL: Min. 7/16-in. depth of sealant fill material is to be applied to the recess around the top surface of the floor through-penetration opening. The sealant material overlapped the concrete and duct assembly a nom. 1/4-in.

Listed Manufacturer:

3M -

Firestopping

Firestopping Sealants

3M Fire Barrier™ 2000+ Silicone Joint Sealant

3M Fire Barrier™ 1000 N/S Silicone Joint Sealant

Through-Penetration Fire Stop Systems

3M Fire Barrier™ 1003 S/L Silicone Joint Sealant

2. PACKING MATERIAL: Fill the annular space with scrap 3M Fire Barrier Duct Wrap 15A or 20A, or 4 pcf mineral wool**, or unfaced 1-1/2-in. or 2-in. thick 8 pcf insulation**. Cut the insulation into strips. Then compress it approximately 25% and insert it into the opening to fill the entire annular space. Fill the slab depth with packing material and recess the surface of packing material a min. 7/16 in. from the top surface of the floor, as required to accommodate the

necessary depth of caulk fill material. (** Listed with Omega Point Laboratories)

Listed Manufacturer:

3M -

Insulation

Mineral Wool Blanket

3M Fire Barrier Duct Wrap 15A

3M Fire Barrier Duct Wrap 20A