

Parklex Prodema USA, Inc.
Design No. PUI/CWP 30-04
Exterior Non-Load Bearing Wall Assembly
NATURCLAD- W F Panels
NFPA 285
Rating: Meets Conditions of Acceptance

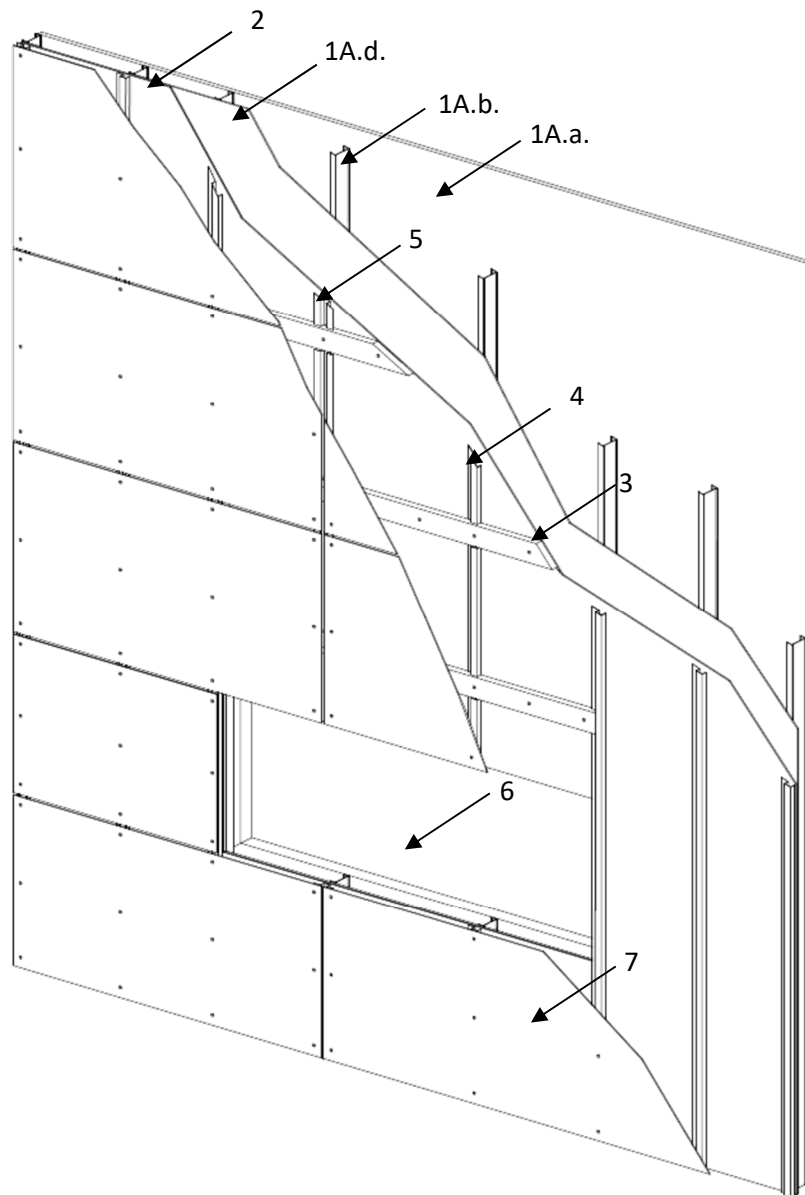


Figure 1 – Assembly Components

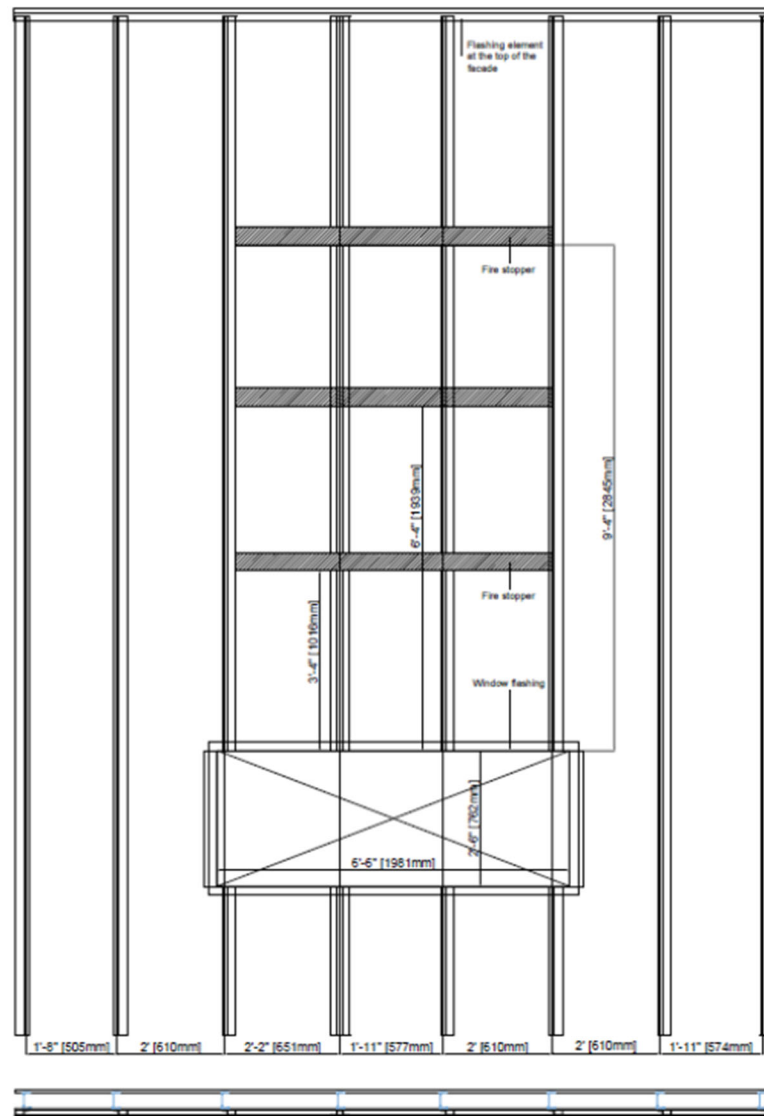


Figure 2 – Placement of Fire Barrier

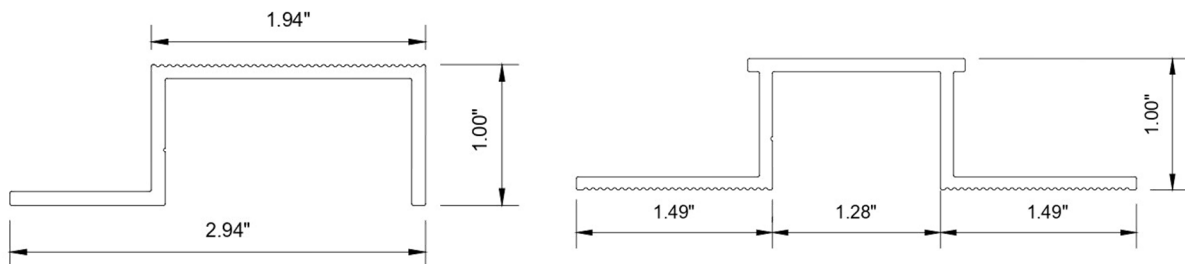


Figure 3 – J- and H-Section Studs

1. **BASE WALL CONSTRUCTION:** Construct a wall assembly that shall comply with the local Building Code or other applicable regulatory requirements as established by the local Authority Having Jurisdiction. The wall shall be one of the following noncombustible constructions:

A. STEEL-FRAMED WALL ASSEMBLY –

a. **INTERIOR CLADDING:** Install nominal 15mm thick, moisture resistant gypsum boards, meeting Type H1 requirements according to EN 520, e.g. ISOPLAC Type H1 gypsum boards, on steel studs using self-drilling steel screws of Ø3.5mm × 25mm dimensions.

JOINT TAPE AND COMPOUND – (Not Shown) 51mm wide, Micro-perforated and damp proof, ISOPRACTIC paper joint tape or equivalent (weight: 142 gsm) embedded in joint compound, ISOPRACTIC PJP or equivalent (density: 1.7 g/cm³), is used along the horizontal and vertical joints on the interior cladding panels.

b. **STEEL STUDS:** Horizontal U-section steel channels, 0.55mm thick PLACO Rail 90 30mm × 90mm × 30mm, are attached using zinc-coated screws of Ø6.3mm × 25mm dimensions. Install vertical C-Section steel studs, 0.6mm thick PLACO Montante 90, 41mm × 88.5mm × 39mm section, max. spacing 610mm, attached to horizontal channel by metal-to-metal self-drilling steel screws of Ø3.5mm × 9.5mm dimensions. Steel framing must comply with EN 14195.

c. **FIRESTOP:** (Not Shown) Install 100mm wide strips of 120mm thick, A1 EN 13501-1 classified, dual density 110-40 kg/m³, mineral wool insulation fire stopping, e.g.

ROCKWOOL Ventirock Duo/120, on the horizontal channels along the floor line.

d. **EXTERIOR SHEATHING:** Install nominal 12.5mm thick, glass-mat faced gypsum boards, meeting Type GM-H1R-A1 requirements according to EN 15283-1, e.g. FIBRANGyps NEXTBOARD gypsum boards, on steel studs using self-drilling steel screws of Ø4.2mm × 39mm dimensions.

JOINT TAPE AND COMPOUND – (Not Shown) 100mm wide, fiber-glass mesh tape, Tramaglass 160 R131 A101 joint tape or equivalent (weight: 160 gsm) embedded in cement mortar, FIBRANGyps NEXT COAT or similar (density: 1.35 g/cm³), is used along the horizontal and vertical joints on the exterior sheathing panels.

B. CONCRETE CONSTRUCTION.

C. MASONRY CONSTRUCTION.

2. **WATER-RESISTIVE BARRIER:** Attach, 0.175mm thick, 68 gsm, DuPont Tyvek® FireCurb®, high-density polyethylene (HDPE) breather membrane (BBA Certificate Number: 90/2548) to Exterior Sheathing using staples.

3. **FIRE BARRIER:** Attach Intertek Listed Tenmat FF102/50 ventilated cavity fire barrier ([Spec ID 55536](#)) to a solid substrate using stainless-steel screws of Ø5mm × 70mm dimensions, spaced at 250mm. The fire barrier must be positioned with a maximum gap of 1-in. between the barrier and the inner face of the exterior cladding. Three fire barriers must be installed above opening, for the full width of the opening, and located at approximate 40 in. intervals, located below horizontal joints in the exterior cladding panels (Item 7).

- 4. J-SECTION STUD:** 6063-T5 aluminum J-section studs (Dimensions: 3 in. (74.7mm) × 1 in. (25.4mm) and 2.5mm thick), spaced at 24 in., are installed vertically on the base-wall steel framing using DIN 7504-K zinc-plated steel screws having Ø5.5mm × 25 mm dimensions. When attached to a concrete or masonry wall, equivalent fastening must be designed by a licensed design professional.
- 5. H-SECTION STUD:** 6063-T5 aluminum H-section studs (Dimensions: 4.5 in. (107.9mm) × 1 in. (25.4mm) and 2.5mm thick) are installed vertically along the vertical joints of the Exterior Cladding panels (Item 7), on the base-wall steel framing using DIN 7504-K zinc-plated steel screws having Ø5.5mm × 25mm dimensions. When attached to a concrete or masonry wall, equivalent fastening must be designed by a licensed design professional.
- 6. EXTERIOR INSULATION:** Min. 1-in., 4 pcf noncombustible mineral wool insulation may be installed over the exterior sheathing provided the max. 1-in. air gap limit is maintained. The mineral wool must be installed with girts sized for the insulation thickness.
- 7. WINDOW OPENINGS:** Window openings are first covered with one layer of exterior sheathing boards and then L-shape galvanized steel profile flashings of 1mm thickness and 115mm × 60mm section are attached to steel channels along the window perimeter using DIN 7504-K zinc-plated steel screws of Ø5.5mm × 38mm dimensions, covering the inside face of the opening and lapping on to the exterior cladding panels.
- 8. EXTERIOR CLADDING PANELS**

CERTIFIED PRODUCT: Parklex Prodema USA, Inc.'s NATURCLAD-W F Panels.

8mm thick NATURCLAD-W F High Pressure Laminate (HPL) panels have nominal max. dimensions of 8 ft. (2440mm) in length and 4 ft. (1220mm) in height. The panels are attached to the vertical J- and H-section stud profiles using A2 stainless steel screws of Ø5.5mm × 30mm dimensions, placed at the top, middle, and bottom of the panel at each J- and H-section stud. Vertical joints must be placed over H-section studs. The panels must be installed with a max. of 8mm open vertical and horizontal joints.

This Design Listing is intended to provide guidance for on-site verification of the installation of system components and shall not be used in place of the manufacturer's published installation instructions. The manufacturer is responsible for providing installation instructions and requirements that ensure compliance with the system as tested and evaluated by Intertek. Installation must comply with this Design Listing, the manufacturer's installation instructions, and the applicable Code. In the event of conflict, this Design Listing governs.

Compliance of the assembly described in this Design Listing with the referenced standard(s) is contingent upon verification that the field-constructed assembly is consistent with the assembly described herein. Intertek-certified products may be verified by the authorized Intertek label. Products not bearing the Intertek label shall be verified by the Authority Having Jurisdiction as meeting the specifications stated herein.

This Design Listing is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of that agreement. Intertek assumes no liability to any party other than the Client, in accordance with the agreement, for any loss, expense, or damage arising from the use of this document. Only the Client is authorized to permit copying or distribution of this Design Listing, and only in its entirety. Partial reproduction or distribution of excerpts is not permitted.

Refer to the listing report in the Directory of Building Products (<https://bpdirectory.intertek.com>) for the applicable edition of the referenced standard(s).