

Design Number TFI/BPF 120-08

PERIMETER FIRE BARRIERS

Thermafiber, Inc.

FireSpan® 90 and FireSpan® 40 and Safing™

ASTM E 2307

T-Rating Refer to Compression Percentage

F-Rating 2 hr

ASTM E 2307/ASTM E 1399 Cycling

Class IV: 500 cycles @ 30 cpm

Rated for ± 16.7% horizontal movement @ 50% Compression (Reference Item 3A): T-Rating 1/4 hr


Rated for ± 11% horizontal movement @ 33% Compression (Reference Item 3A): T-Rating 0 hr

Rated for ± 5% horizontal movement @ 20% Compression (Reference Item 3A): T-Rating 0 hr

Rated for ± 6.25% vertical shear movement @ 50% Compression (Reference Item 3A): T-Rating 0 hr

UL 2079

L-Rating ambient and elevated (400°F): <1.0 SCFM/LF

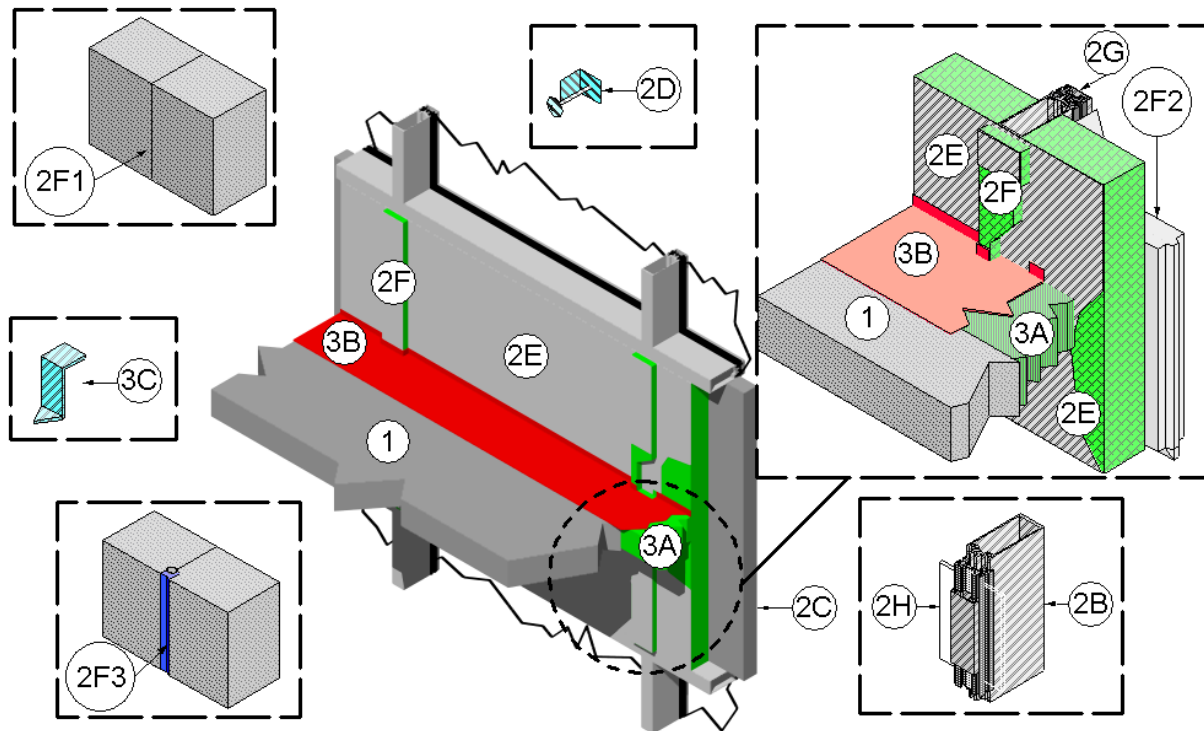

1. CONCRETE FLOOR ASSEMBLY: Two hour rated concrete floor assembly made from either lightweight or normal weight concrete with a density of 100 to 150 pcf, having a minimum thickness of 4-1/2 in. at the joint face. When a longitudinal recess (blockout) is required to contain an architectural joint system, increase concrete floor assembly

thickness to maintain a minimum thickness of 4-1/2 in. and accommodate depth of blockout formed in the concrete: blockout width unrestricted.

2. CURTAIN WALL ASSEMBLY: Incorporate the following construction features:

Division 07 Thermal Protection

07-84-00 Firestopping

07-84-53 Building Perimeter Firestopping

Page 2 of 4

- A. Mounting Attachment: (Not shown) Attach aluminum framing (Item 2B) to the structural framing according to the curtain wall manufacturer's instructions. When required, connect the mounting attachments to the joint face of the concrete floor assembly (Item 1) according to the curtain wall manufacturer's instructions. Limit distance between mounting attachments to maximum 120 in. on center (oc).
- B. Aluminum Framing: Use rectangular aluminum tubing mullions and transoms. Minimum required framing dimensions, use 0.100 in. thick walls with minimum 6-1/2 in. depth and maximum 2-1/2 in. width. Space mullions maximum 48 in. oc and space transoms minimum 69 in. oc. Locate transoms at a height of 33 in. above the top surface of the concrete floor assembly (Item 1) as measured from the bottom of the transom.
- C. Concrete Panels: Use any non-combustible exterior concrete based panels. Use minimum 1-1/2 in. thick, 12 in. high, 12 in. long panels. Attach concrete panels to aluminum framing (Item 2B) according to the curtain wall system manufacturer's requirements.
- D. Impaling Pins: (Optional) Install minimum 12 GA steel pins sized to extend minimum 1/2 in. through the framing covers (Item 2G). Attach pins using a 2 in. x 2 in. steel plate, 2 in. x 2 in. steel angle or directly attached to the steel stud framing (Item 2B) using a stud gun. Space pins maximum 12 in. oc.

- E. CERTIFIED COMPANY:
Thermafiber, Inc.

CERTIFIED PRODUCT: Insulation
Mineral Wool

MODEL: Thermafiber, Inc.
FireSpan® 90 and FireSpan® 40

Curtain Wall Insulation: Use nominal 24 in. wide, 4 in. thick, 4 pcf density or 2 in. thick, 8 pcf density, mineral wool batt insulation. Install curtain wall insulation by fitting in each stud cavity between aluminum framing (Item 2B) using clips or impaling pins (Item 2D). Maintain 1-1/4 in. air cavity between curtain wall insulation and concrete panels (Item 2C). Tightly compress together butt joints in the lengths of curtain wall insulation by using minimum 1/4 in. compression per piece of curtain wall insulation material. Tape all adjacent edges between curtain wall insulation, or between aluminum framing (Item 2B) and curtain wall insulation, with minimum 4 in. wide pressure sensitive aluminum foil tape, centered over the seam. Locate horizontal seams in the curtain wall insulation at least 6 in. above or below the top surface of the perimeter joint protection (Item 3).

- F. Concrete Panel Joint: No through joints allowed. When required, the surface of the concrete panel joints can be sealed with gaskets or sealants. Use one of the following for vertical and horizontal concrete panel joints:
 - I. flush type (butt joint) (Item 2F1),
 - II. key way type (tongue and groove) (Item 2F2), or
 - III. recessed (Item 2F3).

- G. CERTIFIED COMPANY:
Thermafiber, Inc.

CERTIFIED PRODUCT: Insulation
Mineral Wool

MODEL: Thermafiber, Inc.
FireSpan® 90

Framing Covers: Make from strips of 1 in., 8 pcf density, mineral wool batt insulation faced on one side with aluminum foil scrim (vapor retarder), which is exposed to the room interior. Cut strips a minimum

Division 07 Thermal Protection

07-84-00 Firestopping

07-84-53 Building Perimeter Firestopping

Page 3 of 4

1-1/2 in. wider than aluminum framing (Item 2B). Center framing covers over all aluminum framing (Item 2B) and secure using impaling pins (Item 2D) welded to aluminum framing using a stud gun. Do not pass framing covers through the perimeter joint protection (Item 3). Allow framing covers to abut the top and the bottom surfaces of the perimeter joint protection (Item 3) provided that no deformation occurs.

- H. Glass Vision Panels: When required, use optional glass vision panels a minimum 33 in. above the top surface of the floor assembly (Item 1). Install glass vision panels to curtain wall framing according to the curtain wall system manufacturer's guidelines. Use a minimum 1/4 in. thick, clear tempered glass with a nominal width and height as determined by the framing.
- I. Window Gaskets: When optional glass vision panels used, secure glass vision panels with a thermal break (thermal-set rubber extrusion).
- J. Window Framing: Use rectangular aluminum tubing mullions and transoms, sized according to the curtain wall system manufacturer's guidelines. Minimum required framing dimensions, use 0.100 in. thick walls with minimum 6-1/2 in. depth and minimum 2-1/2 in. width and window framing must be compatible with aluminum framing (2B). Locate window framing at least 33 in. above the top surface of the floor assembly.

- 3. PERIMETER JOINT PROTECTION: Do not exceed an 8 in. nominal joint width (joint width at installation). Incorporate the following construction features for the perimeter joint protection (also known as perimeter fire barrier system):

- A. CERTIFIED COMPANY:
Thermafiber, Inc.

CERTIFIED PRODUCT: Insulation
Mineral Wool

MODEL : Thermafiber, Inc. Safing
™

Packing Material: Use a minimum 4 in. thick, 4 pcf density, mineral wool batt insulation installed with the fibers running parallel to the edge of concrete floor assembly (Item 1) and curtain wall assembly (Item 2). Cut packing material width to achieve required compression, refer below, when installed in the nominal joint width. Compress the packing material into the perimeter joint. Tightly compress together splices (butt joints) in the lengths of packing material by using minimum 1/4 in. compression per piece of packing material. When a spray coating is used, locate the top surface of the packing material flush with the top surface of the concrete floor assembly (Item 1). When the non-sag or self leveling silicone sealant is used, recess the top surface of the packing material 1/4 in. from the top surface of the concrete floor assembly (Item 1).

- I. When 50% compression is required cut the width of the packing material 2 times wider than the nominal joint width.
 - II. When 33% compression is required cut the width of the packing material 1.5 times wider than the nominal joint width.
 - III. When 20% compression is required cut the width of the packing material 1.25 times wider than the nominal joint width.
- B. Fill, Void or Cavity Material: Apply 3M FireDam™ Spray 200 (Elastomeric, Sprayable) or Fire Barrier™ 1000 N/S Silicone Sealant (Non-sag) or FB 1003 S/L (Self Leveling) Sealant (bearing the Intertek Certification Mark) over the packing material (Item 3A) as follows:

Spray Coating – Spray apply the liquid to cover the exposed top surface of the packing material (Item 3A) compressed and installed in the perimeter joint. Apply a minimum wet film thickness of 1/8 in. and overlap the spray coating a minimum 1/2 in. onto the adjacent curtain wall assembly (Item 2) and concrete floor assembly (Item 1). When the spraying process is stopped and the applied spray coating cures to an elastomeric film before installation process is restarted, then overlap the edge of the cured spray coating at least 1/8 in. with the liquid spray coating.

Sealant – Apply non-sag or self leveling sealant to cover the exposed surface of the packing material (Item 3A) compressed and installed in the perimeter joint. Apply minimum 1/4 in. thickness non-sag or self leveling sealant over the packing material (Item 3A) and finish flush with the top surface of the concrete floor assembly (Item 1).

- C. Support Clips: (Optional)
Recommended for installations subject to vertical shear movement. Use standard 20 GA galvanized steel Z-shaped clips having the following nominal dimensions: 1 in. wide by 3 in. high with a 2 in. upper leg and a 3 in. lower leg. Install 3 in. horizontal leg impaled into packing material (Item 3A) mid-depth and the 2 in. horizontal leg on top of the concrete floor assembly (Item 1). Install clips adjacent to mounting bracket (Item 2A) and spaced maximum 12 in. oc.